


Medium Voltage Distribution

Evolis circuit breakers 17.5 kV

vacuum breaking
fixed and withdrawable versions

Catalogue
2011

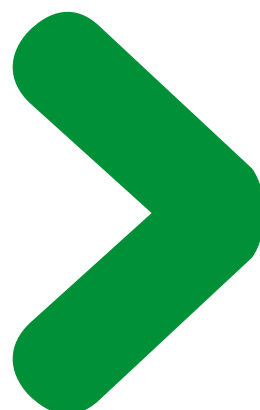

Schneider
Electric

General contents

General presentation

2



Panorama

8



Evolis 17.5 kV
fixed version

11



Evolis 17.5 kV
withdrawable version
in NEX cradle

31



Evolis 17.5 kV
withdrawable version
in MC cassette

53



Evolis HP
withdrawable version
in MC cassette

73



Evolis: a range of circuit breakers that takes account of your electrical installations' requirements today and in the future.

Description

Evolis: a range of vacuum-type circuit breakers from 7.2 kV to 24 kV, combining easy selection and a comprehensive offer:

- a fixed, frontal or lateral version
- a withdrawable, frontal version with a circuit breaker and its cradle or its cassette
- a fixed, lateral version equipped with an integrated protection chain
- separately delivered accessories.

The Evolis circuit breaker is operated via a spring mechanism that gives an operating speed that is independent of the operator and that does not require an auxiliary power supply.

When the operating mechanism is motorized the circuit breaker can include telecontrol functions and carry out rapid reclosing cycles.

The various circuit breaker versions are easy to integrate in a cubicle environment. An Installation Guide details the required procedure.

Applications

Evolis is intended for use in medium voltage network applications, in new installations or renovation, for utilities companies, infrastructures, the process industry and the tertiary sector.

It provides protection for all types of applications: cables, overhead lines, motors, capacitors, transformers, source busbar sections, etc.

Evolis, a fixed, frontal or lateral version

Here the circuit breaker is in its simplest version. In this case it can be combined with additional accessories to meet various requirements.

For the fixed lateral version, the MV connection can be on the right or on the left depending on the type of circuit breaker.



Evolis 17.5 kV fixed, frontal version



Evolis 24 kV fixed, frontal version ()*



*Evolis 24 kV fixed, lateral version
MV connection on the left hand side (*)*



*Evolis 24 kV fixed, lateral version
MV connection on the right hand side (*)*

(*) The Evolis 24 kV offer is covered in a separate catalog (ref. AMTED307011EN).

Evolis

Circuit breakers adapted to your needs

(cont.)

Evolis: a withdrawable, frontal version

In this version, the circuit breaker is equipped with arms, clusters, a rack, and cradle or cassette. The cradle and the circuit breaker can be ordered and delivered separately.



Evolis 17.5 kV withdrawable, frontal version in NEX cradle



Evolis 24 kV withdrawable, frontal version in NEX cradle ()*



Evolis HP withdrawable, frontal version in MC cassette



Evolis 17.5 kV withdrawable, frontal version in MC cassette

EVOset: a fixed, lateral version equipped with an integrated protection chain

The EVOset is provided with a fully autonomous integrated protection chain (with a VIP type control unit) operating without an auxiliary power source. The protection unit exists in 4 models: VIP30, VIP35, VIP300P and VIP300LL. VIP protection units are associated with functional current sensors. The circuit breaker is delivered with its factory-tested protection chain. It therefore simplifies the panel builder's installation work.



EVOset 24 kV fixed, lateral version MV connection on the right hand side ()*

(*) The Evolis 24 kV offer is covered in a separate catalog (ref. AMTED307011EN).

As a specialist in breaking technologies, Schneider Electric took naturally an interest in vacuum breaking techniques. A major R&D investment was made to develop and engineer Evolis, providing customers with the very best of vacuum technology.

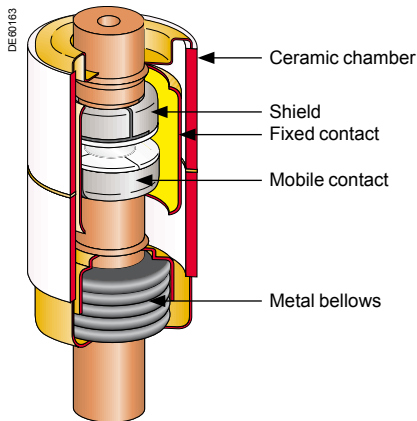


Fig. 1: vacuum interrupter components

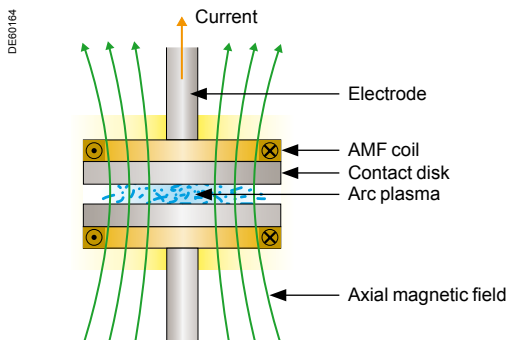


Fig. 2: cross-section of AMF contact



Fig. 3: diffuse vacuum arc AMF technology

Make-up of a vacuum interrupter

Vacuum interrupters basically have two electrical contacts (fig.1), one fixed and the other mobile, and a sealed enclosure. The latter enables a high level of vacuum to be maintained inside the interrupter (less than 10^{-2} Pa) to provide insulation between the open contacts.

The dielectric strength of the vacuum allows the contact-to-contact distance to be reduced. This short distance together with the low opening speed allow the use of a low energy control mechanism. A metal clusters provides the link between the mobile contact and the enclosure.

In order to keep the vacuum level required for the correct operation of the interrupter for 30 years, the enclosure must be perfectly sealed, and the various components have to be fully degased. This is achieved by:

- choosing materials that are specifically selected for this application (metals and ceramics)
- choosing an appropriate assembly process (vacuum, high temperature brazing)
- the use of a "getter" material to absorb the residual gas.

Current breaking in a vacuum interrupter

In vacuum breaking, the electrical arc generated on separation of the contacts is made up of a plasma of metal vapors produced by the vaporization of the contact material.

At low values of current, these vapors very quickly condense on the shield and contacts when the arc disappears, thus allowing:

- the vacuum to be re-established
- a contact-to-contact dielectric strength to be restored that is greater than
- the recovery voltage: breaking is then complete.

At high currents, the electrical arc in the vacuum switches to a concentrated mode which causes high, localized temperature rises on the contacts. The existence of these hot spots is detrimental to the quick restoring of the dielectric strength.

Two techniques can be used in order to avoid this stagnation of the static concentrated arc:

- the so called RMF (Radial Magnetic Field) technique, involves rotating the arc thanks to an electromagnetic effect generated by a radial magnetic field; this therefore limits contact erosion.
- a more recent technique called AMF (Axial Magnetic Field) involves applying an axial magnetic field parallel to the axis of the two contacts (fig. 2) which allows a diffuse arc to be maintained (fig. 3) even at high current values. The arc energy is spread over the whole contact surface area, therefore causing very low levels of erosion.

- Schneider Electric has chosen this last technique for the Evolis range.

Schneider Electric's choices for Evolis combined with its industrial expertise provides customer with a highly reliable range of circuit breakers. These products are suitable for the most demanding conditions with the guarantee of full compliance with international standards.

AMF technology

Evolis circuit breakers use AMF type vacuum interrupters.

According to technical and economic optimization considerations, the axial magnetic field is generated:

- either by a coil outside of the interrupter (fig. 4), for rated voltages up to 17.5 kV
- or by a coil integrated in the interrupter contact structure (fig. 5), for the 24 kV voltage level.

In both cases the AMF vacuum interrupters feature low arc voltages (U_{arc} of around 50 V) and maximum usage of the contact surface for very low contact erosion.

The advantages provided

The above choices provide customers with the following advantages in MV circuit breaker applications:

- simple and compact vacuum interrupters
- high electrical endurance meaning that there is no need for contact wear inspection in normal network protection applications including highly disturbed overhead line feeders.

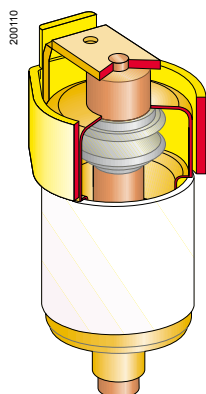


Fig. 4: 17.5 kV external coil type interrupter

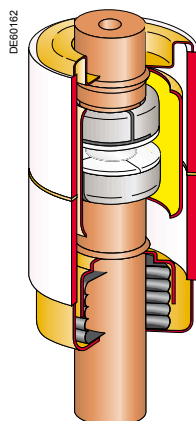


Fig. 5: 24 kV internal coil type interrupter

PE55694



Vacuum interrupter

PE55695



Industrial process expertise

Systematic advanced control

The main components of the circuit breaker, such as vacuum interrupter and operating mechanism, are produced by Schneider Electric. The vacuum interrupters are manufactured in an ultra-modern production unit in France.

During manufacture, each circuit breaker is subjected to systematic advanced testing.

Vacuum interrupter testing

The level of vacuum in each interrupter is tested using the "magnetron discharge method".

Using this sophisticated procedure, measurement is very precise and does not require access to the inside of the interrupter, thus not affecting the airtight seal.

Circuit breaker testing

A rigorous set of tests and measurements is carried out on each circuit breaker.

The results are reported and signed off by the quality control department on each device's test certificate to ensure product traceability.

Compliance with standards

- Evolis complies with IEC 62271-100.
- Design and production are certified to ISO 9001: 2000.
- Production sites are certified to ISO 14001 (environmental standard).

DE55745



DE55746



Certification

The certificate of conformity provides guarantees that the circuit breaker:

- has been subject to type tests according to EN 45001 standards procedures in accredited laboratories by independent organizations
- is in conformity with recognized international standards.

Evolis is currently being certified by external EN 45011 accredited organizations, members of the STL (Short circuit Testing Liaison):

- EN 45001: general requirements for the competence of testing and calibration laboratories
- EN 45011: general requirements for bodies of operating product certification systems.

Environmental care

Product design takes account of the environmental constraints described in a "Product Environment Profile" dossier (PEP).

An end-of-service-life manual details procedures for dismantling and processing components.

PEG002

Circuit breaker

- cradle

Instrument transformer

MV cubicle components

- capacitor insulator
- earthing switch
- heating resistor
- voltage presence indicator
- crank
- extraction table

LV cubicle components


- Mcb
- protection relay
- lamp
- push button
- terminal blocks
- connector

Protection and control

- UMI


Metering

- VPIS
- PM700 or PM800

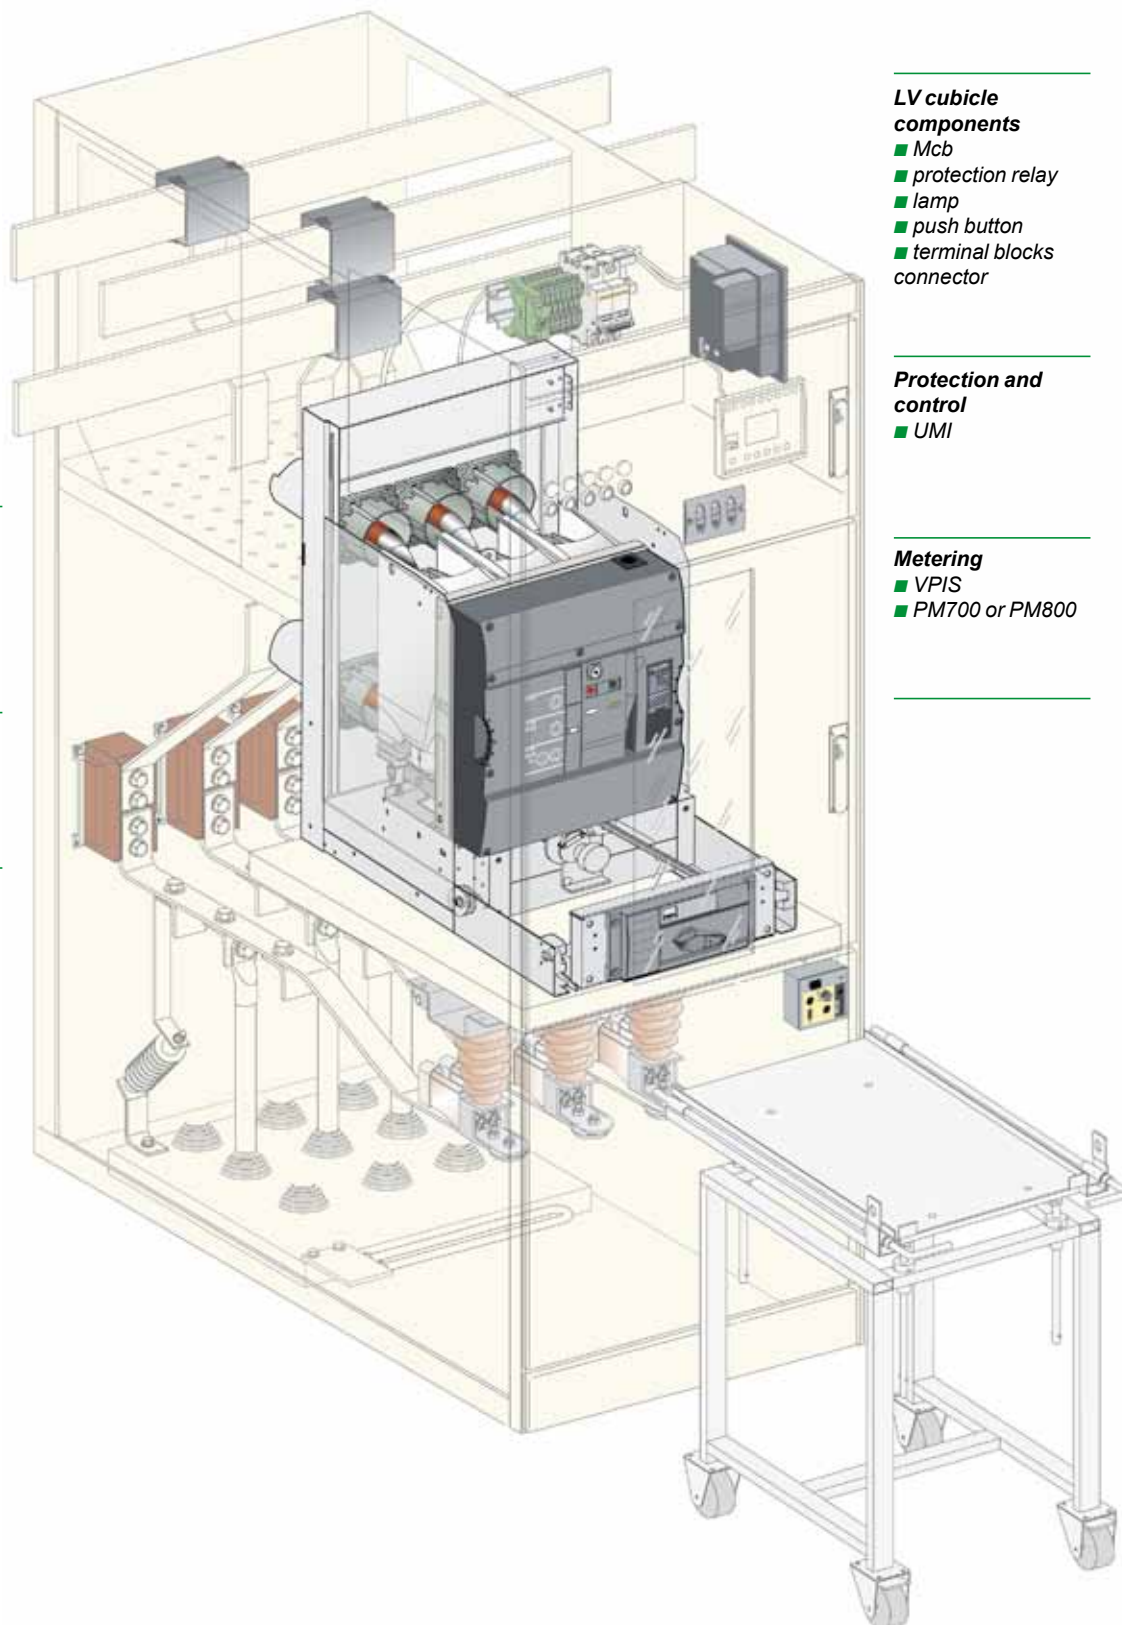




Circuit breakers

Evolis from 7.2 kV to 17.5 kV

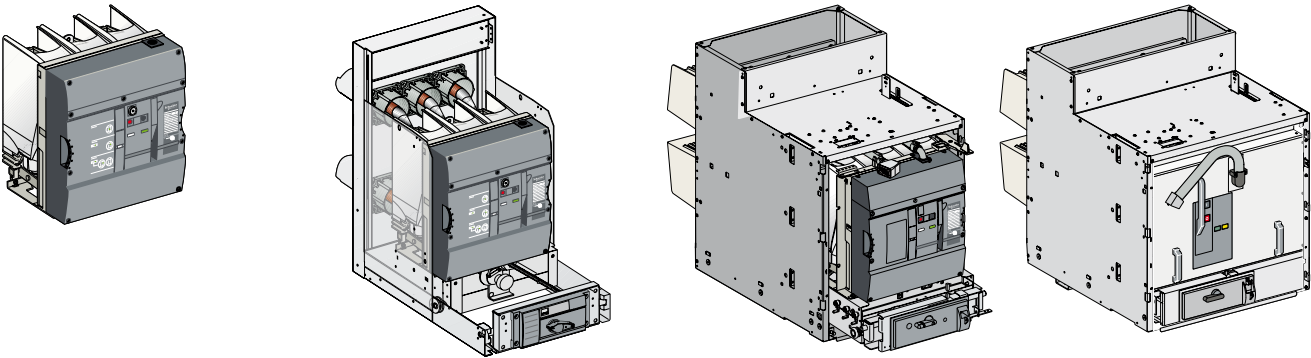


Fixed version Operating mechanism on the front	Withdrawable version in NEX cradle Operating mechanism on the front	Withdrawable version in MC cassette Operating mechanism on the front	Withdrawable HP version in MC cassette Operating mechanism on the front
Rated voltage U_r (kV, 50/60 Hz)			
7.2 12 17.5	7.2 12 17.5	7.2 12 17.5	7.2 12 15
Short circuit rated breaking capacity (I_{sc})			
from 25 to 40 kA	from 25 to 40 kA	from 25 to 40 kA	from 25 to 50 kA
Rated current (I_r)			
from 630 to 2500 A	from 630 to 2500 A	from 630 to 2500 A	from 1250 to 3150 A

Evolis 24 kV

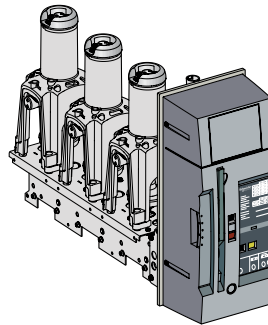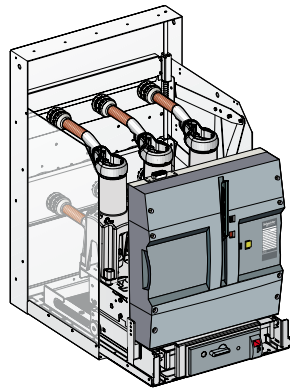

EVOset 24 kV

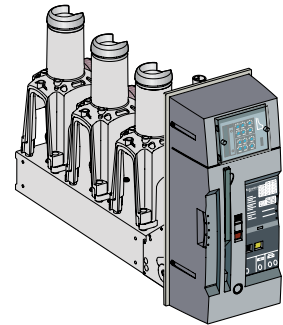**Fixed version**Operating mechanism
on the front**Withdrawable version**Operating mechanism
on the front**Fixed version**Operating mechanism
on the side**Fixed version**Integrated protection system
Operating mechanism
on the side**Rated voltage U_r (kV, 50/60 Hz)**

24

24

24

24

Short circuit rated breaking capacity (I_{sc})

from 16 to 31.5 kA

from 16 to 31.5 kA

from 12.5 to 25 kA

from 12.5 to 20 kA

Rated current (I_r)

from 630 to 2500 A

from 630 to 2500 A


630 and 1250 A

630 and 1250 A

Separate catalogue

Protection, monitoring and control

Protection



VIP30
for phase protection

VIP35
for phase and earthing
protection

VIP300P
for phase protection

VIP300LL
for phase and earthing
protection

Protection
and control

Sepam series 20
for normal applications

Sepam series 40
for demanding
applications

Sepam series 80
for full applications

Metering



PM700
for basic metering

PM800
for advanced metering

CM3000, CM4000
for full metering
and power quality

Separate catalogue

Presentation	13
Main characteristics	14
Description of functions	16
MV connection	16
LV connection	18
P2 stored energy operating mechanism	19
Wiring diagram	19
Opening circuit	20
Remote control	22
Indication	23
Locking/interlocking	24
Dimensions	25
Order form	26
Offer structure	27
Separated components	27
Services	29



PE60083



Evolis circuit breaker 17.5 kV fixed version

Description of the device

The Evolis circuit breaker comprises a basic fixed version:

- 3 poles integrated in a "sealed pressure system" type insulating enclosure.
 - a P2 type, spring-operated stored energy control mechanism, electrifiable.
- This gives the device an opening and closing speed that is independent of the operator, for both electrical and manual orders. It enables reclosing cycles to be carried out
- a front panel housing the manual operating mechanism and status indicators
 - upstream and downstream terminals for the power circuit connection
 - a terminal block for connection of external auxiliary circuits.

Each device can also be fitted with the following options:

- a supporting frame equipped with rollers and ground fixing brackets for fixed installation
- circuit breaker locking in the open position by a keylock installed on the front plate of the operating mechanism
- a 18-pin or 42-pin Harting type LV connector.

Applications

Evolis circuit breakers are three-pole indoor MV circuit breakers.

They are mainly used for operation and protection of public, industrial and tertiary distribution networks from 7.2 to 17.5 kV.

Through their compact dimensions and harmonized range, Evolis circuit breakers are positioned very favorably on the retrofit market.



Electrical characteristics according to IEC 62271-100

Phase to phase		mm	145			
Rated voltage	Ur	kV 50/60 Hz	7.2	12		
Insulation level						
- power frequency withstand	Ud	kV 50 Hz 1 min ⁽¹⁾	20	28		
- lightning impulse withstand	Up	kV peak	60	75		
Rated current	Ir	A	630	■	■	■
		1250	■	■	■	■
		1600	—	—	—	—
		2500	—	—	—	—
Short circuit current	Isc	kA	25	31.5	25	31.5
Short time withstand current	Ik/tk	kA/3 s	25	31.5	25	31.5
Short-circuit making current	Ip	kA peak	50 Hz	63	79	63
		60 Hz	65	82	65	82

Common characteristics according to IEC 62271-100

Rated switching sequence	O-3 min-CO-3 min-CO	■
	O-0.3 s-CO-3 min-CO	■
	O-0.3 s-CO-15 s-CO	■
Operating times	Opening	< 50 ms
	Breaking	< 60 ms
	Closing	< 65 ms
Service temperature	T	°C
		– 25 to + 40
Mechanical endurance	Class	M1 ⁽²⁾ - M2
	Number of switching operations	2000 ⁽²⁾ - 10 000
Electrical endurance	Class	E2
Number of switching operations at full Isc value	25 kA	100
	31.5 kA	50
	40 kA	30
Capacitive current breaking capacity	Class	C1
Average relative humidity	Over 24 h	< 95%
	Over 1 month	< 90%

Switching and protection of capacitor banks

Evolis range circuit breakers are well suited for switching and protection of capacitor banks with installed power up to 2 Mvar installed in series with dampening reactor limiting inrush current to 2 kA.

Evolis is also well suited for capacitor banks system with installed power higher than 2 Mvar in conjunction with anti-harmonic filtering system.

Please consult us.


185																		240								
	7.2						12			17.5			7.2			12			17.5							
	20						28			38			20			28			38							
	60						75			95			60			75			95							
	■	■	■	■	■	■	■	■	—	—	■	—	—	■	—	—	■									
	■	■	■	■	■	■	■	■	—	—	■	—	—	■	—	—	■									
	■	■	■	■	■	■	—	—	—	—	—	—	—	—	—	—	—									
	—	—	—	—	—	—	—	—	■	■	■	■	■	■	■	■	■									
	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾									
	25	31.5	40	25	31.5	40	25	31.5	25	31.5	40	25	31.5	40	25	31.5	40									
	63	79	100	63	79	100	63	79	63	79	100	63	79	100	63	79	100									
	65	82	104	65	82	104	65	82	65	82	104	65	82	104	65	82	104									

(1) Circuit breaker tested at Ud 42 kV 50 Hz, 1 min


(2) Class M1: 2000 operations for I_{sc} = 40 kA

■ Available

— Not available.

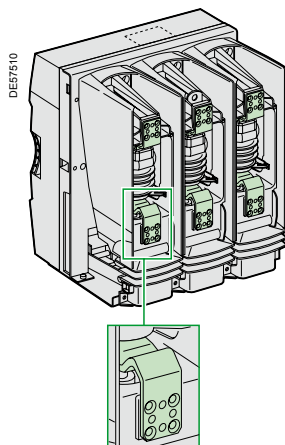

Connection terminal

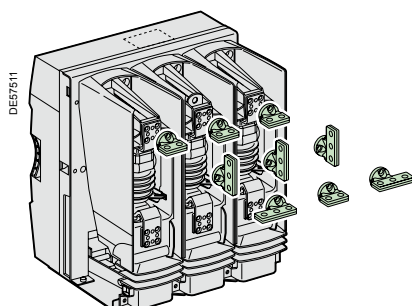


3 connector sets

Composition


The basic circuit breaker is equipped with drilled copper connection terminals, at the top and bottom of the breaking units. The connectors are fitted to the terminals using the corresponding bolts. Several variants are possible.

Fixed connectors


Horizontal connectors (H)



Vertical connectors (V)




Mixed connectors




An adjustable connector enables the vertical distance to be increased to enable rotation of 90°.

Adjustable gap connectors

Extendable connectors horizontal (H)




Extendable connectors vertical (V)



An adjustable connector enables the connection distance to be increased from 0 to 25 mm.

Mixed solution

Example




Comment:


The insulation withstand values given in the performance table, do not take account of the connectors.

With these connectors it is possible to use unplated or tin-plated copper conductors or tin-plated aluminium conductors, without any specific precautions being required. The shape and dimensions of these conductors must be determined by the panel builder according to the dielectric withstand and temperature rise characteristics of the whole connection system.


Typical examples are provided in the Installation Guide.

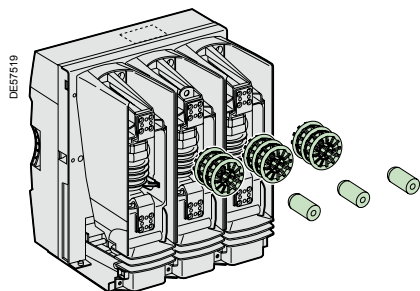

Clusters and fingers

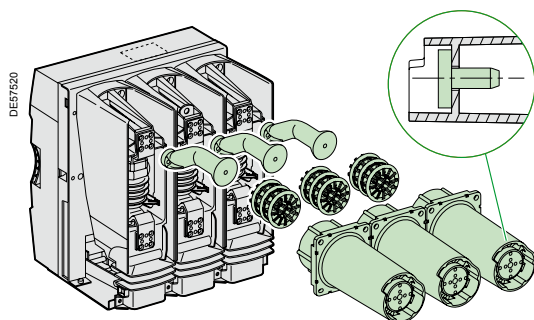

Arms and bushings

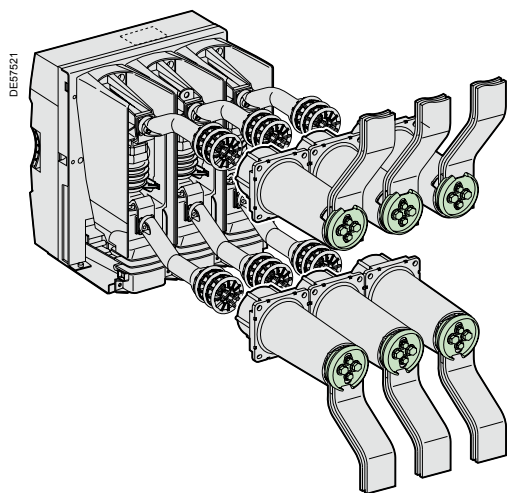

Arms, clusters, fingers and bushings, busbars and field deflectors

Composition

Panels builders with own cubicle designs (including the racking truck) can transform a fixed device into a withdrawable device by adding the following assemblies:

- arms
- clusters
- fingers
- bushings
- field deflectors.

Cluster and finger

- The tulip type cluster has a shape which provides maximum contact surface whilst optimising heat dissipation. Moreover, in the case of short-circuit, it offers good compensation characteristics for electrodynamic forces.
- The finger is a component designed specifically for the cluster, regarding its shape, tolerances and materials. Contact between the finger and the cluster is guaranteed by type testing: 1000 racking in-out operations.

Arm and bushing

- The arms cylindrical shape optimizes dielectric strength and avoids the need for any additional insulation.
- The bushing's cylindrical shape gives it outstanding dielectric strength.
- The previously described connectors can be mounted on bushing connection terminals.

Comment:


Performance levels of the whole assembled unit must be tested by the panel builder. Installation conditions for the two units presented above are described in the Installation Guide.

For the 17.5 kV withdrawable circuit breaker, phase to phase distance 185 mm, field deflectors must be added to the bushings.

Field deflectors


For circuit breakers with a rated voltage of $U_r = 17.5$ kV with a phase to phase distance of 185 mm, field deflectors are used to increase the dielectric strength by 75 kV to 95 kV.

DE57522

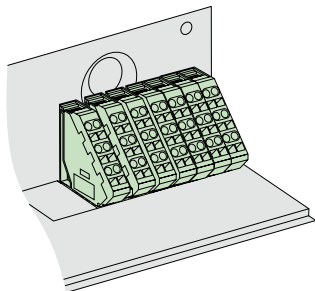


LV terminal block

DE57523

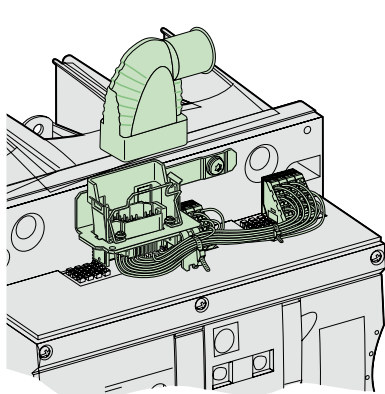

18-pin version LV plug

DE57524

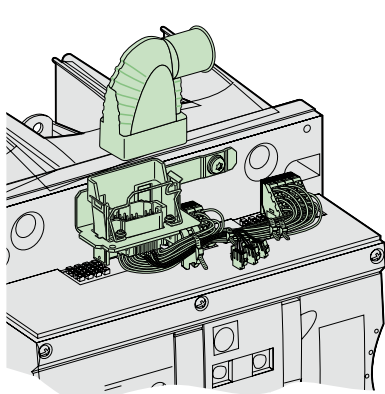

42-pin version LV plug

Two connection solutions

■ Directly on the LV terminal block

The circuit breaker's LV wiring can be directly connected to the LV terminal block of the operating mechanism through a cable protection duct.

■ With LV plug

- The fixed part (male) mounted on the circuit breaker and fully connected to the operating mechanism
- The mobile part (female) compatible with the male part.

Two versions of the LV plug are available

An 18-pin version, enabling connection of:

- a shunt opening release MX1
 - a remote control mechanism (electrical motor, shunt closing release XF, anti-pumping relay)
 - a "ready to close" contact PF
 - a maximum number of 4 auxiliary contacts.
- (see "indication" page, "Open/closed position auxiliary contacts" chapter).

An 24-pin version, enabling connection of:

- an opening release (shunt type MX1 or undervoltage type MN)
 - a second opening release (shunt type MX2 or undervoltage type MN)
 - a low energy release (Mitop)
 - a fault trip indicator contact SDE
 - a remote contact reset system SDE
 - a remote control mechanism (electrical motor, shunt closing release XF)
 - a "ready to close" contact PF
 - a maximum number of 11 auxiliary contacts.
- (see "indication" page, "Open/closed position auxiliary contacts" chapter).

Note: see the table of the releases' combinations "Order form" page.

LV wiring kit

A wiring kit with 21 or 42 wires (2 meters long) equipped with pins that can be adapted to the LV plug can be supplied for connected in to the cubicle's LV compartment.

Flexible ducting

This 525 mm long duct with a hinged LV plug, enables protection of the LV wiring that connects the circuit breaker to the cubicle's LV compartment.

Interlocking kit

For circuit breakers intended for withdrawable applications, an interlocking kit can be adapted. The kit enables the mechanical position status to be given ("connected/disconnected") of the LV plug. By adding a link between this mechanical data (by the customer) and the open/closed position of the circuit breaker, interlocking can be achieved between the LV plug and the open/closed position of the circuit breaker (required by IEC standard 62271-200).

A detailed explanation of operation is given in the Installation Guide.

Description of functions

P2 stored energy operating mechanism

Wiring diagram

PE56600



Operation of the P2 stored energy operating mechanism


This gives the device an opening and closing speed that is independent of the operator whether the order is electrical or manual.


The electrical control mechanism carries out reclosing cycles and is automatically recharged by a geared motor each time after closing.

It consists of:


- the stored energy operating mechanism which stores in springs the energy required to open and close the device
- a gear motor electrical charging device with manual charging by lever (useful on loss of auxiliary supply)
- manual order devices by push buttons on the front panel of the device
- an electrical remote closing device containing a release with an antipumping relay
- an electrical opening device containing one or more releases, for example:
 - shunt opening
 - undervoltage
 - Mitop, a low consumption release, used only with the Sepam 100 LA protection relay.
- an operation counter
- a position indication device by mechanical indicator and 3 modules of 4 auxiliary contacts whose availability varies according to the diagram used
- a device for indicating "charged" operating mechanism status by mechanical indicator and electrical contact.

Wiring diagram (principle)

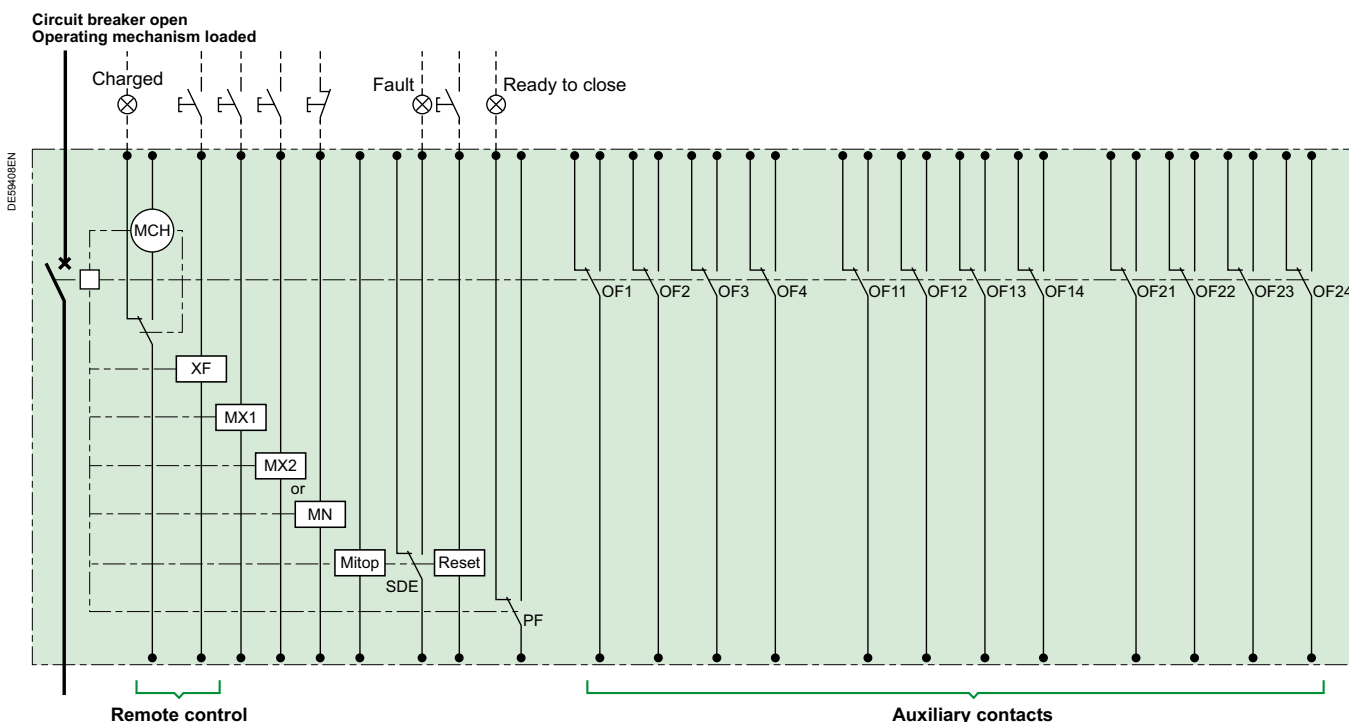

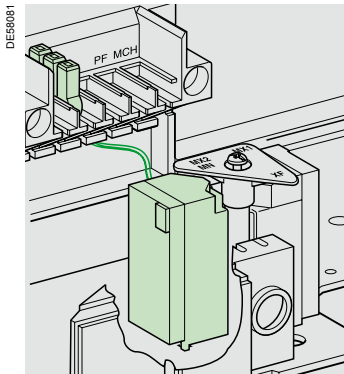

Circuit breaker equipped with
a shunt opening release MX



Shunt opening release (MX1 and MX2)

Composition

The opening circuit is produced using the following components:


- a shunt opening release (MX1)
- a second shunt opening release (MX2)
- undervoltage release (MN)
- time delayed undervoltage release (MNR: MN + time delay).
The time delay, placed outside the circuit breaker, can be disabled by an emergency stop button to give instant circuit breaker opening.
- low energy release (Mitop).

Note: see the table of the releases' combinations on the following page.


Shunt opening release (MX1 and MX2)

Energizing this release causes instant opening of the circuit breaker.
Permanent power supply to the MX unit locks the circuit breaker in the "open" position.


Characteristics		
Power supply	See "Order form" page	
Threshold	0.7 to 1.1 Ur	
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Undervoltage release (MN)



Time delay for undervoltage release (MN)

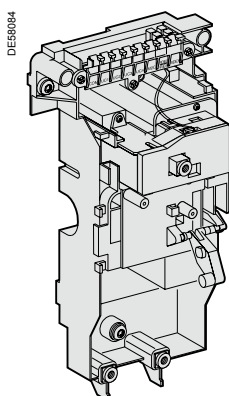

Low energy release (Mitop)

Undervoltage release (MN)

This release unit causes the systematic opening of the circuit breaker when its supply voltage drops below a value less than 35% of the rated voltage, even if this drop is slow and gradual. It can open the circuit breaker between 35% and 70% of its rated voltage. If the release unit is not supplied power, manual or electrical closing of the circuit breaker is impossible. Closing of the circuit breaker is possible when the supply voltage of the release unit reaches 85% of its rated voltage.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5

Time delay for MN

To eliminate spurious tripping of the circuit breaker when there are brief voltage drops, the MN action is controlled with a time delay. This function is achieved by adding a time delay unit outside of the undervoltage release (MN) circuit (adjustable time delay). This unit is placed outside the circuit breaker and can be inhibited by an emergency stop button to obtain instant circuit breaker opening.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5
Time delay	0.5 s - 0.9 s - 1.5 s - 3 s	

Low energy release (Mitop)

This release includes a low consumption unit and is specifically used with the Sepam 100LA self-powered unit ("REFLEX MODULE"), or the VIP relay.

Characteristics

Power supply	Direct current
Threshold	$0.6 \text{ A} < I < 3 \text{ A}$

Any tripping due to the Mitop release unit is momentarily indicated by an SDE type changeover contact, provided with the Mitop.


This release also includes a coil (reset) enabling remote SDE contact reset.

Comment:

Use of the Mitop low energy release requires adjustment of the protection relay time delay in order to ensure that the circuit breaker trips between 45-50 ms.

Releases combinations table

Shunt opening MX1	1			1	1	1		1	1
Shunt opening MX2				1				1	
Undervoltage MN		1			1		1		1
Mitop			1			1	1	1	1

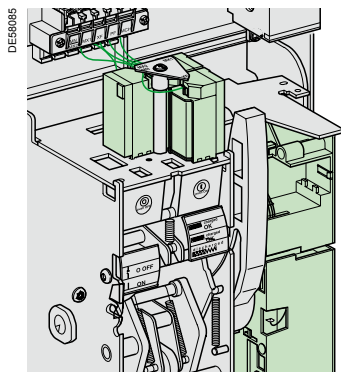

Circuit breaker equipped with remote control

Function

Remote control enables the remote opening and closing of the circuit breaker.

The opening order always takes priority over the closing order.

In the event of simultaneous opening and closing orders, the mechanism discharges under no load, without moving the main contacts. The circuit breaker remains in the "open" position.


In the event of latched opening and closing orders, the mechanism carries out anti-pumping function as standard, by blocking the circuit breaker in the "open" position.

Anti-pumping function: after opening on a fault or deliberate opening via the manual or electrical mechanism, the closing order must be interrupted then reactivated to enable reclosing of the circuit breaker.

Composition

The remote control comprises:

- an electrical motor (MCH) equipped with a "spring armed" CH limit switch
- a shunt closing release (XF).



Electrical motor MCH

Electrical motor (MCH)


The electrical motor carries out the automatic rearming of the storage energy springs as soon as the circuit breaker closes. This allows instant reclosing of the device after opening. The arming lever is only used as a backup control in the case of the absence of the auxiliary power supply.

An electrical motor (MCH) equipped with a "spring armed" CH limit switch.

This contact indicates the "armed" position of the mechanism (springs armed).

Characteristics

Power supply	See "Order form" page	
Threshold	0.85 to 1.1 Ur	
Consumption (VA or W)	180	
Motor overcurrent	2 to 3 In for 0.1 s	
Arming time	6 s maximum	
Operating rate	3 cycles maximum per minute	
CH contact	10 A/240 V	




Shunt closing release XF

Shunt closing release (XF)

This release allows remote closing of the circuit breaker when the control mechanism is armed. It can be permanently or briefly supplied power.

Characteristics XF

Power supply	See "Order form" page	
Threshold	XF	0.85 to 1.1 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Rotary type contacts (OC)

“Open/closed” auxiliary position contacts (OC)

These auxiliary contacts indicate the “open” or “closed” position of the circuit breaker.

■ Rotary type changeover contacts directly controlled by the circuit breaker mechanism.

■ Indicator contacts are proposed:

□ for standard relaying applications


□ for low level control applications with plc's or electronic circuits.

This version is compatible with Sepam series 20-40-80 units.

Characteristics

Standard delivery	4		
Maximum quantity	12		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	10/6 *
		480	10/6 *
		690	6
	V DC	24/48	10/6 *
		125	10/6 *
		250	3
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	6
		240	6
		380	3
	V DC	24/48	6
		125	6
		250	3

* Standard contacts: 10 A; optional contacts: 6 A (temperature derating)



“Ready to close” PF contact

“Ready to close” PF contact

The circuit breaker is “ready to close” when shown by a mechanical indicator and a PF changeover contact.

This information simultaneously indicates that:

■ the circuit breaker is open

■ the storage energy springs are armed

■ there is no permanent closing order


■ there is no permanent opening order caused by:

□ a safety opening order (2nd MX or MN)

□ keylocking of the device in the open position.

Characteristics

Standard delivery	0		
Maximum quantity	1		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	5
		480	5
		690	3
	V DC	24/48	3
		125	0.3
		250	0.15
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	3
		240	3
		380	3
	V DC	24/48	3
		125	0.3
		250	0.15



Operation counter (CDM)



Operation counter (CDM)

The operation counter is visible on the front panel.


It totalizes the number of switching cycles (CO) that the device has carried out.

Description of functions


Locking/interlocking

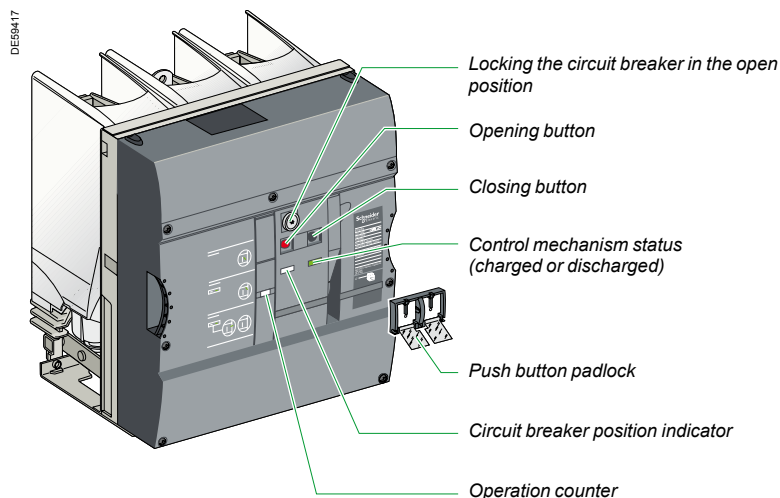

Push button padlock



Padlocking of the circuit breaker in the "open" position

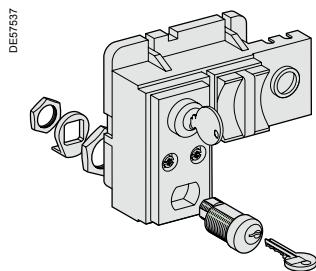


Keylocking of the circuit breaker in the "open" position

Push button padlock


This transparent screen blocks access to the opening and closing push-buttons on the circuit breaker.
The device enables the opening or closing push button to be locked independently. It is often associated with an electrical motor (MCH).

Locking is achieved either:

- by 2 screws
- by 3 padlocks, not supplied
- by a lead seal.

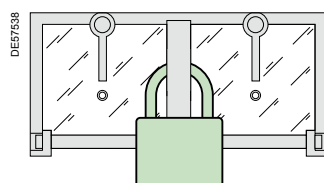

Padlocking

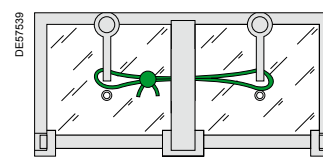

Lead sealing

Locking of the circuit breaker in the "open" position

The circuit breaker is locked in the "open" position by blocking the opening push button in the engaged position:

- by a padlock 1 to 3 padlocks, not supplied
- by a keylocks 1 or 2 different keylocks, not supplied



The keylocks are of captive key type, with the key free after locking, either Profalux or Ronis (right turn), and are proposed according to the options either with:

- 1 single keylock
 - 1 single keylock mounted on the circuit breaker + 1 identical delivered separately for interlocking with another device
 - 2 different keylocks for double locking.
- Profalux and Ronis keylocks are inter-compatible.

Device



Phase to phase distance 145 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	630 A	51 kg
		1250 A	
	31.5 kA	630 A	
12 kV	25 kA	630 A	
		1250 A	
	31.5 kA	630 A	
		1250 A	





Phase to phase distance 185 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	630 A	55 kg
		1250 A	
	31.5 kA	630 A	
		1250 A	
	40 kA	630 A	
12 kV	25 kA	630 A	
		1250 A	
	31.5 kA	630 A	
		1250 A	
	40 kA	630 A	
17.5 kV	25 kA	630 A	
		1250 A	
	31.5 kA	630 A	
		1250 A	
	40 kA	630 A	
		1250 A	



Phase to phase distance 240 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	2500 A	79 kg
		2500 A	
	31.5 kA	630 A	
		1250 A	
	40 kA	2500 A	
12 kV	25 kA	2500 A	
		2500 A	
	31.5 kA	2500 A	
		2500 A	
	40 kA	630 A	
17.5 kV	25 kA	2500 A	
		2500 A	
	31.5 kA	2500 A	
		2500 A	
	40 kA	630 A	
		1250 A	
		2500 A	



Important

Detailed installation instructions are given in the "Evolis Installation Guide". Please consult us.

Only one of the boxes (ticked ☒ or filled ☐ by the needed value) have to be considered between each horizontal line.

Green box ☒ corresponds to none priced functions.

Releases combinations table

MX1	1			1	1	1		1	1
MX2				1				1	
MN	1			1		1		1	
Mitop		1				1	1	1	1

Basic fixed circuit breaker

Quantity

Rated voltage U_r (kV)

Short-circuit current I_{sc} (kA)

Rated normal current I_r (A)

Phase to phase distance (mm) 145 185 240

Colour for push buttons and indicators

Push buttons open/closed: Red/black ☒
Indicator open/closed: Black/white ☒ Green/red ☒
Operating mechanism charged/discharged: Yellow/white ☒

Circuit breaker options

Opening release (see possible choices in combination table)

Shunt opening release MX1

24 Vac ☒ 24...30 Vdc ☒ 100...130 Vdc/ac ☒
48 Vac ☒ 48...60 Vdc ☒ 200...250 Vdc/ac ☒

Shunt opening release MX2

24 Vac ☐ 24...30 Vdc ☐ 100...130 Vdc/ac ☐
48 Vac ☐ 48...60 Vdc ☐ 200...250 Vdc/ac ☐

Undervoltage release MN

24 Vac ☐ 24...30 Vdc ☐ 100...130 Vdc/ac ☐
48 Vac ☐ 48...60 Vdc ☐ 200...250 Vdc/ac ☐

Time delay for MN

48...60 Vac ☐ 100...130 Vdc/ac ☐ 200...250 Vdc/ac ☐

Low energy release Mitop

☐

Remote control

Electrical motor MCH

24...30 Vdc ☐ 100...125 Vdc ☐ 200...250 Vdc ☐
48...60 Vdc/ac ☐ 100...130 Vac ☐ 200...240 Vac ☐

Shunt closing release XF

24 Vac ☒ 24...30 Vdc ☒ 100...130 Vdc/ac ☒
48 Vac ☒ 48...60 Vdc ☒ 200...250 Vdc/ac ☒

Module of 4 additional auxiliary contacts O/C 1 2

Ready to close contact PF

LV plug

Without interlocking 18 pins 42 pins LV terminal blocks
With interlocking 18 pins 42 pins

Locking of the circuit breaker in the open position

By padlock
or by locks and keys Profalux ☒ Ronis ☒
If locks 1 lock 2 identical locks 2 different locks









Push buttons padlock of O/C circuit breaker








Fixed connections

Upstream and downstream fixed connections, I_r

3 fixed distance H or V 630-1250 A 630-2500 A
3 variable distance H 630-1250 A 630-2500 A
3 variable distance V 630-1250 A 630-2500 A

The following components can be ordered separately and can be adapted or replaced by the customer.

Remote control and opening circuit			Ref.
MX1, MX2, XF shunt opening/closing release			
	24...30 Vdc	24 V 50/60 Hz	59284
	48...60 Vdc	48 V 50/60 Hz	59285
	100...130 Vdc - 50/60 Hz		59286
	200...250 Vdc - 50/60 Hz		59287
Undervoltage release MN			
	24...30 Vdc	24 V 50/60 Hz	59288
	48...60 Vdc	48 V 50/60 Hz	59289
	100...130 Vdc - 50/60 Hz		59290
	200...250 Vdc - 50/60 Hz		59291
Time delay for MN			
	48...60 Vdc - 50/60 Hz		33680
	100...130 Vdc - 50/60 Hz		33681
	200...250 Vdc - 50/60 Hz		33682
Low energy release Mitop			59160
			
Electrical motor MCH			
	24...30 Vdc		47888
	48...60 Vdc		47889
	100...125 Vdc		47890
	200...250 Vdc		47891
	48...60 V - 50/60 Hz		47889
	100...130 V - 50/60 Hz		47893
Additional auxiliary contacts O/C			47894
	Module of 4 contacts		47887
LV terminal blocks			
	1 terminal block		47074
Ready to close contact PF			47080
			
Operation counter CDM			48535
			

MV and LV connection accessories				Ref.
Upstream and downstream fixed connections, Ir				
  	3 fixed distance H or V (fig. 1)	630-1250 A		59400
		630-2500 A *		59409
	3 variable distance H (fig. 3)	630-1250 A		59401
		630-2500 A *		59410
	3 variable distance V (fig. 2)	630-1250 A		59402
		630-2500 A *		59411
(*) For 40 kA, you must take the 630-2500 A versions.				
MV connection accessories				
  	3 clusters + 3 fingers	630-1250 A		59369
		630-2500 A *		59371
	3 arms	630-1250 A		59396
		630-2500 A *		59397
(*) For 40 kA, you must take the 630-2500 A versions.				
Field deflectors for bushings				
	6 deflectors used to increase dielectric withstand from 75 to 95 kV			59283
LV plug				
	Standard 18 pins WITHOUT interlocking			59070
	Standard 18 pins WITH interlocking			59114
	All options 42 pins WITHOUT interlocking			59071
	All options 42 pins WITH interlocking			59115
LV wiring and ducting				
	Flexible conduct for LV wiring			59099
	LV connecting kit 42 wires			AAA10 087
Other circuit breaker accessories				Ref.
Labels kit for push button and indicator (O/C)				
	Circuit breaker specific labels green, red			59100
Circuit breaker opening external device				
	Adaptation kit needed for circuit breaker opening (for retrofit)			59093
Various				Ref.
Circuit breaker support frame				
	Drawings and casters			59050
Technical documentation				
	User manual			59069

The following components can only be adapted or replaced on site by staff trained by Schneider Electric

- Remote control mechanism (comprising: electrical motor, shunt closing release, operation counter)
- Operation counter
- Low energy release (Mitop)
- Circuit breaker front cover.

Presentation	33
Main characteristics	34
Description of functions	36
Racking in	36
MV connection	37
LV connection	38
P2 stored energy operating mechanism	39
Wiring diagram	39
Opening circuit	40
Remote control	42
Indication	43
Locking/interlocking	44
Safety functions	45
Service trucks	46
Dimensions	47
Order form	48
Offer structure	49
Separated components	49
Services	52



PEE7994



*Evolis circuit breakers 17.5 kV
withdrawable version in NEX cradle*

Description of the device

The basic withdrawable version of the Evolis circuit breaker comprises:

- the circuit breaker unit with its operating mechanism:
 - three poles equipped with a vacuum interrupter
 - a P2 type, spring-operated stored energy control mechanism, electrifiable.This gives the device an opening and closing speed that is independent of the operator, for both electrical and manual orders. It enables reclosing cycles to be carried out
- a front panel housing the manual operating mechanism and status indicators.
- the components enabling it to be withdrawable:
 - the circuit breaker is equipped with racking arms and contact fingers and mounted on a racking in/out drive device with a threaded shaft activated by a handle, including all of the safety interlock systems.
 - a Harting type male LV connector allows connection of the external auxiliary circuits.

Each device can optionally be fitted with:

- locking of the circuit breaker in the following positions:
 - open, by a key lock installed on the control panel
 - racked out, by a key lock installed on the drive device.
- the basic NEX cradle, comprising:
 - a metal structure and two guide rails
 - fixed connection fingers insulated by bushings
 - metal shutters to insulate from the HV part
 - safety interlocking systems.
- NEX cradle options:
 - circuit breaker racked-in or out position indicator contacts
 - a circuit breaker racked-in blocking mechanism
 - an extraction tool
 - a foolproof device for the circuit breaker rating.

Applications

Evolis circuit breakers are three-pole indoor MV circuit breakers.

They are mainly used for operation and protection of public, industrial and tertiary distribution networks from 7.2 to 17.5 kV.

Through their compact dimensions and harmonized range, Evolis circuit breakers are positioned very favorably on the retrofit market.



Electrical characteristics according to IEC 62271-100

Phase to phase		mm	145					
Rated voltage	Ur	kV 50/60 Hz	7.2	12	17.5			
Insulation level								
- power frequency withstand	Ud	kV 50 Hz 1 min ⁽¹⁾	20	28	38			
- lightning impulse withstand	Up	kV peak	60	75	95			
Rated current	Ir	A	630	■	■	■	■	■
		1250	■	■	■	■	■	■
		2500	—	—	—	—	—	—
Short circuit current	Isc	kA	25	31.5	25	31.5	25	31.5
Short time withstand current	Ik/tk	kA/3 s	25	31.5	25	31.5	25	31.5
Short-circuit making current	Ip	kA peak	50 Hz	63	79	63	79	63
		60 Hz	65	82	65	82	65	82

Common characteristics according to IEC 62271-100

Rated switching sequence	O-3 min-CO-3 min-CO	■
	O-0.3 s-CO-3 min-CO	■
	O-0.3 s-CO-15 s-CO	■
Operating times	Opening	< 50 ms
	Breaking	< 60 ms
	Closing	< 65 ms
Service temperature	T	°C
Mechanical endurance	Class	M1 ⁽²⁾ - M2
	Number of switching operations	2000 ⁽²⁾ - 10 000
Electrical endurance	Class	E2
Number of switching operations at full Isc value	25 kA	100
	31.5 kA	50
	40 kA	30
Capacitive current breaking capacity	Class	C1
Average relative humidity	Over 24 h	< 95%
	Over 1 month	< 90%

Switching and protection of capacitor banks

Evolis range circuit breakers are well suited for switching and protection of capacitor banks with installed power up to 2 Mvar installed in series with dampening reactor limiting inrush current to 2 kA.

Evolis is also well suited for capacitor banks system with installed power higher than 2 Mvar in conjunction with anti-harmonic filtering system.

Please consult us.






185																		240																	
7.2			12			17.5			7.2			12			17.5																				
20			28			38			20			28			38																				
60			75			95			60			75			95																				
■	■	—	■	■	—	■	■	—	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■						
■	■	—	■	■	—	■	■	—	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■	—	—	■						
—	—	—	—	—	—	—	—	—	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■	■						
25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾							
25	31.5	40	25	31.5	40	25	31.5	25	31.5	40	25	31.5	40	25	31.5	40	25	31.5	40	25	31.5	40	25	31.5	40	25	31.5	40							
63	79	100	63	79	100	63	79	63	79	100	63	79	100	63	79	100	63	79	100	63	79	100	63	79	100	63	79	100							
65	82	104	65	82	104	65	82	65	82	104	65	82	104	65	82	104	65	82	104	65	82	104	65	82	104	65	82	104							

(1) Circuit breaker tested at Ud 42 kV 50 Hz, 1 min

(2) Class M1: 2000 operations for I_{sc} = 40 kA

■ Available

— Not available.

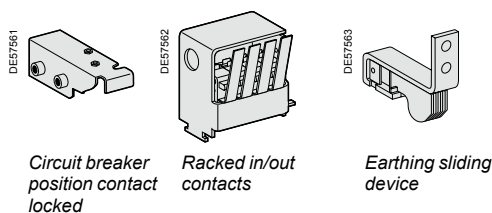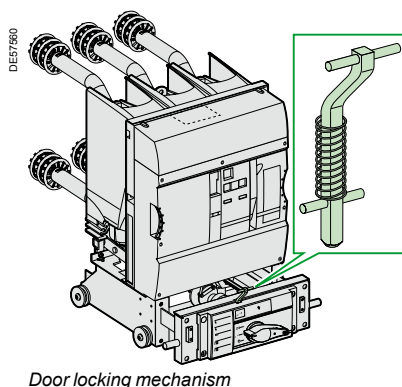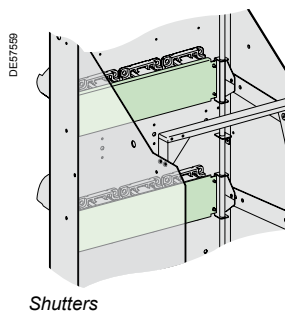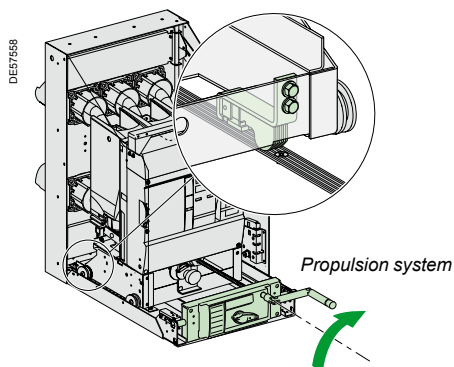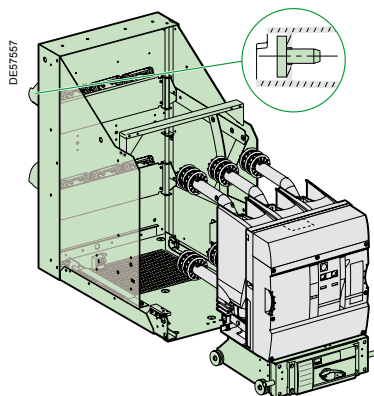

Composition


The "racking in" function is carried out by:

- the racking truck supporting the circuit breaker (mobile part)
- the cradle with bushings (fixed part)
- LV plug.

Operation

The circuit breaker can be placed in 3 stable positions:

- **service position:** circuit breaker racked in and locked in position; LV plugs connected
- **test position:** circuit breaker racked out and locked in position; LV plug connected
- **disconnected position:** circuit breaker racked out and locked in position; LV plug disconnected. The circuit breaker can be unlocked and extracted from the cradle.

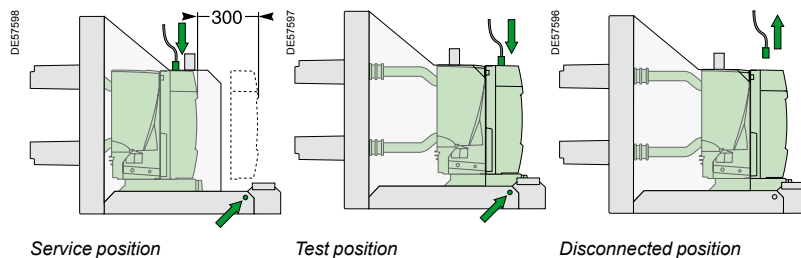


Note: the arrows show the "locked positions" for the circuit breaker and the LV plug.

Functions


- A drive system combined with a threaded shaft gives easier racking in and out. The racking in mechanism can be operated with the door closed.
- An interlock stops the user from inserting the lever as long as the racking truck has not been put in the "racked in/out" position.
- An interlock between the circuit breaker status and the truck gives secure operation: racking in or out is only possible if the circuit breaker is open.
- An interlock also exists between the LV connector and the truck. It is only possible to rack in if the LV connector is connected.
- The cradle floor has all the fixing holes needed to correctly position the earthing switch control mechanism and power circuit. This makes earthing switch operation reliable and gives interlocking between the circuit breaker and the earthing switch.
- Earthing is automatic when the truck is fully racked in.
- Protective shutters stop fingers from touching the racking clusters when the device is extracted (protection index: IP2X).
- For maintenance operations, it is possible to:
 - ☐ padlock the shutters in the closed position
 - ☐ unlock the shutter mechanism to access the racking clusters.
- A foolproof device enables correct matching of the cradle and circuit breaker rating. This system is mounted on the cradle base. Part of the system must be assembled by the panel builder on the cubicle floor.

Accessories


- One set of auxiliary contacts:
 - ☐ 4 circuit breaker racked in/out position contacts
 - ☐ 1 contact showing that the circuit breaker is locked in place on the cradle.
- Cradle earthing is provided by a sliding copper contact.
- A key locking system (Ronis or Profalux) for the circuit breaker in the racked out position enables increased safety downstream of it during work. This system is associated with an earthing switch.
- Locking of the circuit breaker compartment door. This device enables the circuit breaker, full version, to only be operated when the door is closed.

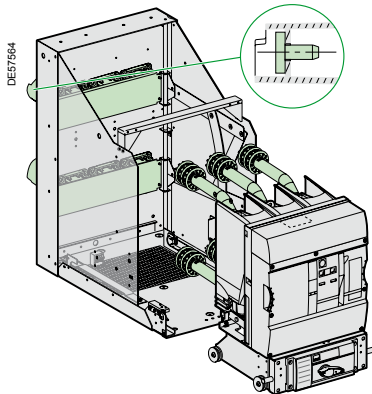

Power circuit

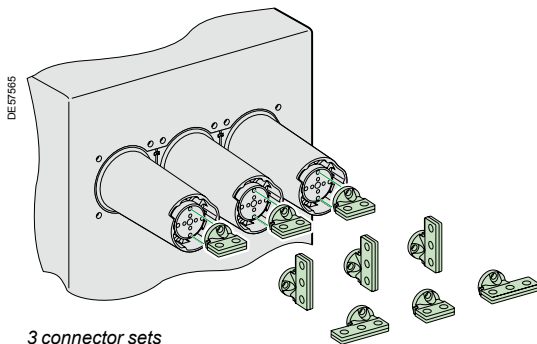

3 connector sets

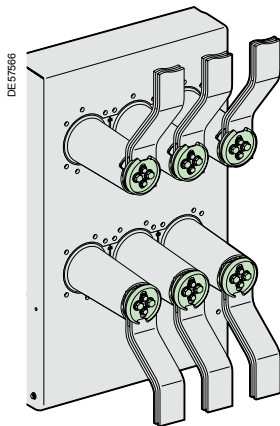

Field deflectors

Composition

The power circuit comprises:

- mobile contacts with disconnectable clusters and arms mounted on the circuit breaker
- fingers attached to the cradle and insulated by bushings and metal shutters.

This assembly provides perfect control of the dielectric strength, mechanic, the short time withstand current and the temperature rise. All of these characteristics have been validated in tests.

Connection

Connection is easily done from outside the cradle:

- on vertical copper terminals integrated in the bushing
- by a connector set, also used on the base circuit breaker.


Note:

The dielectric strength values given in the performance table, do not take these connectors into account.

The panel builder must check the whole cubicle connection configuration.


For circuit breakers with a rated voltage of $U_r = 17.5$ kV with a phase to phase distance of 185 mm, field deflectors are used to increase the dielectric strength by 75 kV to 95 kV.

DE57523

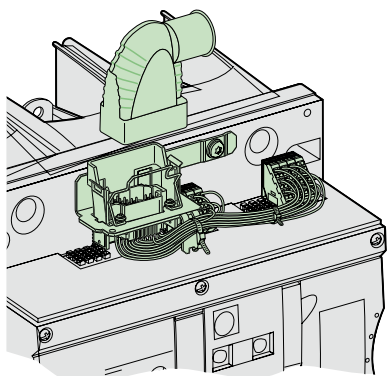

18-pin version LV plug

DE57524

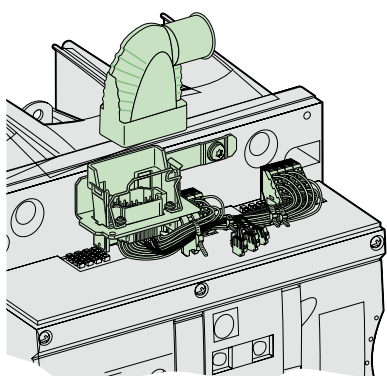

42-pin version LV plug

Main functions

With the base circuit breaker, the LV wiring uses a LV plug which comprises:

- the fixed part (male) mounted on the circuit breaker and fully connected to the control mechanism
- the mobile part (female) compatible with the male part.

Two versions of the LV plug are available

An 18-pin version, enabling connection of:

- a shunt opening release MX1
- a remote control mechanism (electrical motor, shunt closing release XF)
- a "ready to close" contact PF
- a maximum number of auxiliary contacts: 1 NC - 1 NO - 2 changeover contacts. (see "indication" page, "Open/closed position auxiliary contacts" chapter).

An 42-pin version, enabling connection of:

- a shunt opening release MX1
- a second opening release (shunt type MX2 or undervoltage type MN)
- a low energy release (Mitop)
- a fault trip indicator contact SDE
- a remote contact reset system SDE
- a remote control mechanism (electrical motor, shunt closing release XF)
- a "ready to close" contact PF
- a maximum number of auxiliary contacts: 4 NC - 5 NO - 2 changeover contacts. (see "indication" page, "Open/closed position auxiliary contacts" chapter).

Note: see the table of the releases' combinations "Order form" page.

Interlocking function:

In conformity with IEC standard 62271-200, an interlocking function prohibits:

- racking in when the LV plug is not connected
- disconnection of the LV plug if the circuit breaker is in the racked-in position.

LV wiring kit

A wiring kit with 42 wires (2 meters long) equipped with pins that can be adapted to the LV plug can be supplied for connected in to the cubicle's LV compartment.

Flexible ducting

This 525 mm long duct with a hinged LV plug, enables protection of the LV wiring that connects the circuit breaker to the cubicle's LV compartment.

Description of functions

P2 stored energy operating mechanism

Wiring diagram

PE56600



Operation of the P2 stored energy operating mechanism


This gives the device an opening and closing speed that is independent of the operator whether the order is electrical or manual.


The electrical control mechanism carries out reclosing cycles and is automatically recharged by a geared motor each time after closing.

It consists of:


- the stored energy operating mechanism which stores in springs the energy required to open and close the device
- a gear motor electrical charging device with manual charging by lever (useful on loss of auxiliary supply)
- manual order devices by push buttons on the front panel of the device
- an electrical remote closing device containing a release with an antipumping relay
- an electrical opening device containing one or more releases, for example:
 - shunt opening
 - undervoltage
 - Mitop, a low consumption release, used only with the Sepam 100 LA protection relay.
- an operation counter
- a position indication device by mechanical indicator and 3 modules of 4 auxiliary contacts whose availability varies according to the diagram used
- a device for indicating "charged" operating mechanism status by mechanical indicator and electrical contact.

Wiring diagram (principle)

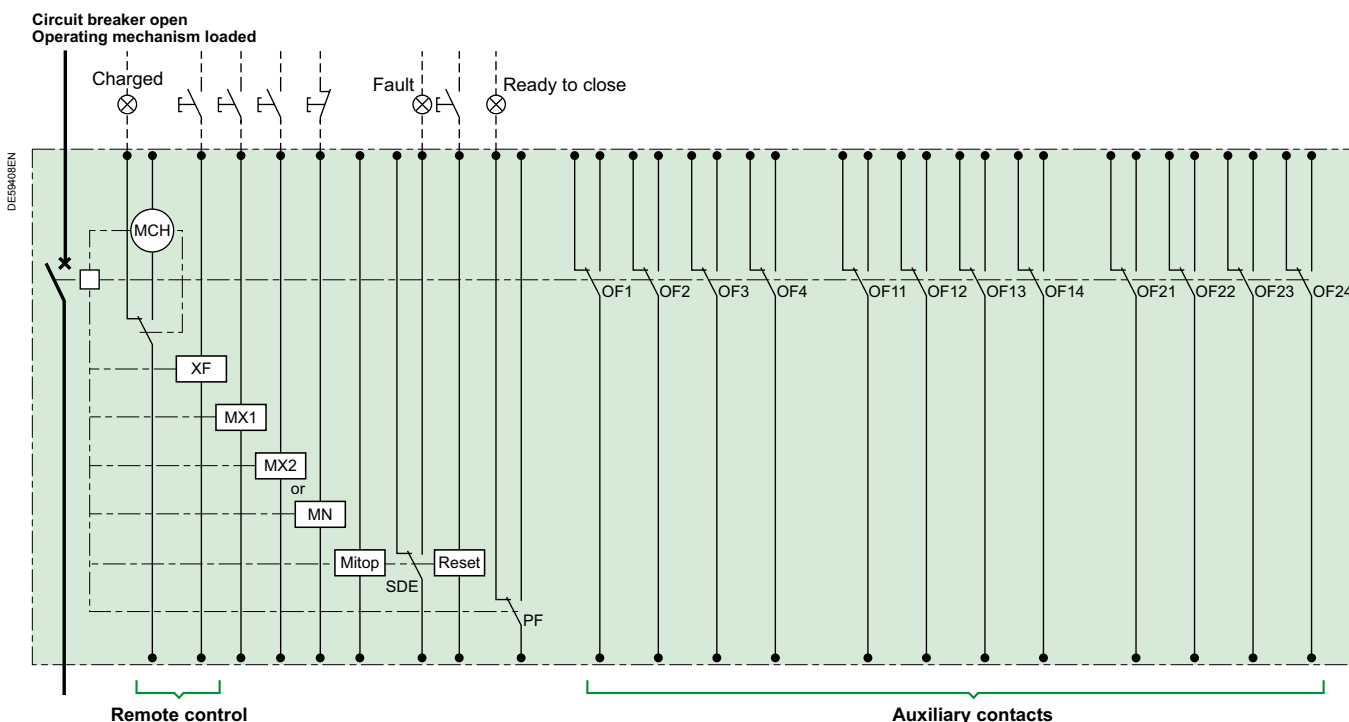

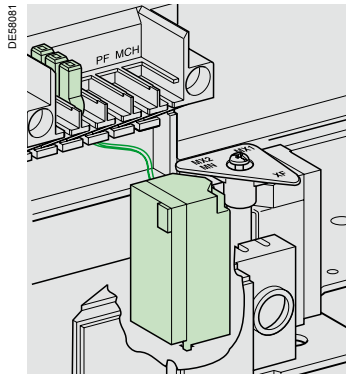

Circuit breaker equipped with
a shunt opening release MX



Shunt opening release (MX1 and MX2)

Composition

The opening circuit is produced using the following components:


- a shunt opening release (MX1)
- a second shunt opening release (MX2)
- undervoltage release (MN)
- time delayed undervoltage release (MNR: MN + time delay).
The time delay, placed outside the circuit breaker, can be disabled by an emergency stop button to give instant circuit breaker opening.
- low energy release (Mitop).

Note: see the table of the releases' combinations on the following page.


Shunt opening release (MX1 and MX2)

Energizing this release causes instant opening of the circuit breaker.
Permanent power supply to the MX unit locks the circuit breaker in the "open" position.


Characteristics		
Power supply	See "Order form" page	
Threshold	0.7 to 1.1 Ur	
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Undervoltage release (MN)



Time delay for undervoltage release (MN)

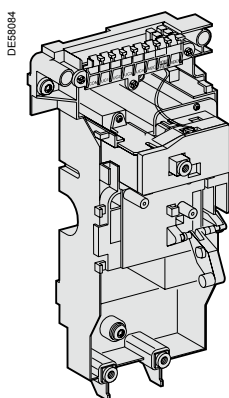

Low energy release (Mitop)

Undervoltage release (MN)

This release unit causes the systematic opening of the circuit breaker when its supply voltage drops below a value less than 35% of the rated voltage, even if this drop is slow and gradual. It can open the circuit breaker between 35% and 70% of its rated voltage. If the release unit is not supplied power, manual or electrical closing of the circuit breaker is impossible. Closing of the circuit breaker is possible when the supply voltage of the release unit reaches 85% of its rated voltage.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5

Time delay for MN

To eliminate spurious tripping of the circuit breaker when there are brief voltage drops, the MN action is controlled with a time delay. This function is achieved by adding a time delay unit outside of the undervoltage release (MN) circuit (adjustable time delay). This unit is placed outside the circuit breaker and can be inhibited by an emergency stop button to obtain instant circuit breaker opening.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5
Time delay	0.5 s - 0.9 s - 1.5 s - 3 s	

Low energy release (Mitop)

This release includes a low consumption unit and is specifically used with the Sepam 100LA self-powered unit ("REFLEX MODULE"), or the VIP relay.

Characteristics

Power supply	Direct current
Threshold	0.6 A < I < 3 A

Any tripping due to the Mitop release unit is momentarily indicated by an SDE type changeover contact, provided with the Mitop.


This release also includes a coil (reset) enabling remote SDE contact reset.

Comment:

Use of the Mitop low energy release requires adjustment of the protection relay time delay in order to ensure that the circuit breaker trips between 45-50 ms.

Releases combinations table

Shunt opening MX1	1	1	1	1	1	1
Shunt opening MX2		1			1	
Undervoltage MN			1			1
Mitop				1	1	1

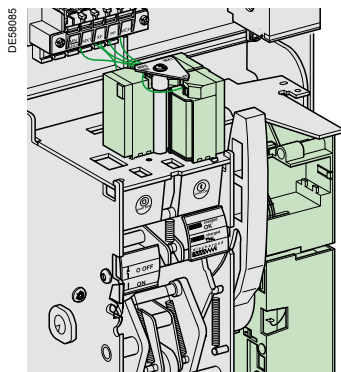

Circuit breaker equipped with remote control

Function

Remote control enables the remote opening and closing of the circuit breaker.

The opening order always takes priority over the closing order.

In the event of simultaneous opening and closing orders, the mechanism discharges under no load, without moving the main contacts. The circuit breaker remains in the "open" position.


In the event of latched opening and closing orders, the mechanism carries out anti-pumping function as standard, by blocking the circuit breaker in the "open" position.

Anti-pumping function: after opening on a fault or deliberate opening via the manual or electrical mechanism, the closing order must be interrupted then reactivated to enable reclosing of the circuit breaker.

Composition

The remote control comprises:

- an electrical motor (MCH) equipped with a "spring armed" CH limit switch
- a shunt closing release (XF).



Electrical motor MCH

Electrical motor (MCH)


The electrical motor carries out the automatic rearming of the storage energy springs as soon as the circuit breaker closes. This allows instant reclosing of the device after opening. The arming lever is only used as a backup control in the case of the absence of the auxiliary power supply.

An electrical motor (MCH) equipped with a "spring armed" CH limit switch.

This contact indicates the "armed" position of the mechanism (springs armed).

Characteristics

Power supply	See "Order form" page	
Threshold	0.85 to 1.1 Ur	
Consumption (VA or W)	180	
Motor overcurrent	2 to 3 In for 0.1 s	
Arming time	6 s maximum	
Operating rate	3 cycles maximum per minute	
CH contact	10 A/240 V	




Shunt closing release XF

Shunt closing release (XF)

This release allows remote closing of the circuit breaker when the control mechanism is armed. It can be permanently or briefly supplied power.

Characteristics XF

Power supply	See "Order form" page	
Threshold	XF	0.85 to 1.1 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Rotary type contacts (OC)

“Open/closed” auxiliary position contacts (OC)

These auxiliary contacts indicate the “open” or “closed” position of the circuit breaker.

■ Rotary type changeover contacts directly controlled by the circuit breaker mechanism.

■ Indicator contacts are proposed:

□ for standard relaying applications


□ for low level control applications with plc's or electronic circuits.

This version is compatible with Sepam series 20-40-80 units.

Characteristics

Standard delivery	4		
Maximum quantity	12		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	10/6 *
		480	10/6 *
		690	6
	V DC	24/48	10/6 *
		125	10/6 *
		250	3
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	6
		240	6
		380	3
	V DC	24/48	6
		125	6
		250	3

* Standard contacts: 10 A; optional contacts: 6 A (temperature derating)



“Ready to close” PF contact

“Ready to close” PF contact

The circuit breaker is “ready to close” when shown by a mechanical indicator and a PF changeover contact.

This information simultaneously indicates that:

■ the circuit breaker is open

■ the storage energy springs are armed

■ there is no permanent closing order


■ there is no permanent opening order caused by:

□ a safety opening order (2nd MX or MN)

□ keylocking of the device in the open position.

Characteristics

Standard delivery	0		
Maximum quantity	1		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	5
		480	5
		690	3
	V DC	24/48	3
		125	0.3
		250	0.15
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	3
		240	3
		380	3
	V DC	24/48	3
		125	0.3
		250	0.15



Operation counter (CDM)



Operation counter (CDM)

The operation counter is visible on the front panel.


It totalizes the number of switching cycles (CO) that the device has carried out.

Description of functions


Locking/interlocking

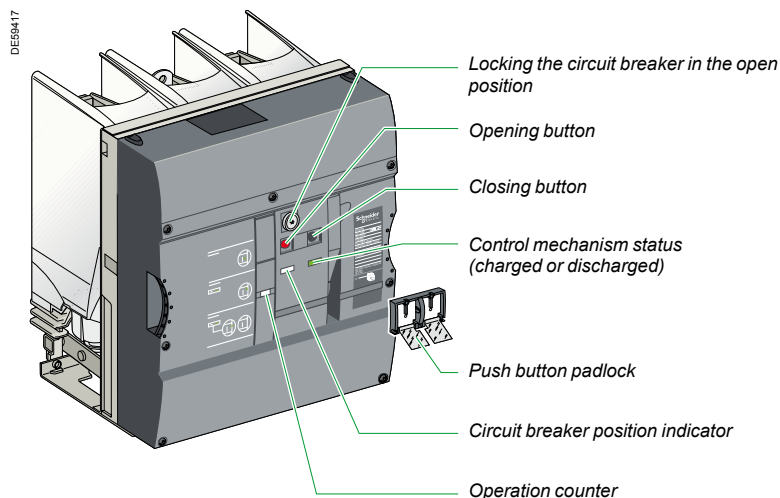


Push button padlock



Padlocking of the circuit breaker in the "open" position

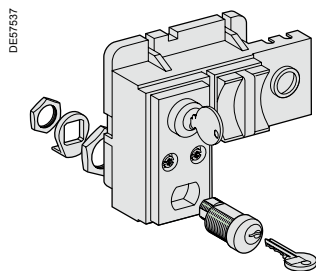

Keylocking of the circuit breaker in the "open" position

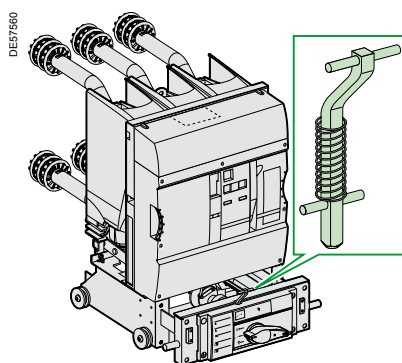


Cubicle door interlocking mechanism

Push button padlock


This transparent screen blocks access to the opening and closing push-buttons on the circuit breaker.
The device enables the opening or closing push button to be locked independently. It is often associated with an electrical motor (MCH).

Locking is achieved either:

- by 2 screws
- by 3 padlocks, not supplied
- by a lead seal.

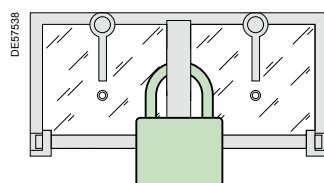

Padlocking

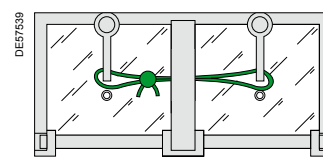

Lead sealing

Locking of the circuit breaker in the "open" position

The circuit breaker is locked in the "open" position by blocking the opening push button in the engaged position:

- by a padlock 1 to 3 padlocks, not supplied
- by a keylocks 1 or 2 different keylocks, not supplied

The keylocks are of captive key type, with the key free after locking, either Profalux or Ronis (right turn), and are proposed according to the options either with:

- 1 single keylock
 - 1 single keylock mounted on the circuit breaker + 1 identical delivered separately for interlocking with another device
 - 2 different keylocks for double locking.
- Profalux and Ronis keylocks are inter-compatible.

Cubicle door interlocking mechanism

This device enables the circuit breaker to only be operated when the door is closed, for the withdrawable version with a cradle.

Description of functions




Safety functions

This table describes the safety functions available on the withdrawable version of the Evolis 17.5 kV circuit breaker.

How to use the table

Each of the boxes describes the functional status of each circuit breaker position and the associated parts:

-  Possible status
-  Possible status, impossible operation
-  Impossible status


Parts		Circuit breaker positions					
			Insertion -----> <----- Extraction			Racking-in -----> <----- Racking-out	
		Removed		Disconnected	Test position		Service
1 - Cradle			Fool-proof protection ⁽¹⁾ Anti-drop ⁽²⁾				
		No opening shutters					
		Shutters padlocking possible					
2 - LV plug	Disconnected			No door closing			
	Connected				No unplugging		
3 - Circuit breaker	Closed				No racking-in		No racking-out
	Open					No closing	
		Open position circuit breaker locking available					
4 - Switchboard door	Open				No racking-in		
	Closed				No door opening ⁽³⁾		
5 - Earthing switch	Open					No earthing switch closing	
	Closed				No racking-in		

⁽¹⁾ This protection mechanism ensures that the performance levels of the circuit breaker correspond with those of the cradle.


⁽²⁾ Device that prevents the circuit breaker from dropping when extracted from the cradle.

The device can be either unlocked manually or when the extraction rig is put in position.

⁽³⁾ Interlocking device to be fitted to the cubicle door. If there is no interlocking, the circuit breaker device should be inhibited.



Disconnecting truck



Earthing truck

Disconnecting truck

This device allows disconnection of the upstream and downstream circuits in the cubicle. It is installed in the same location as the withdrawable circuit breaker in the cradle.

It includes a device to lock it in the in-service position.

Electrical characteristics

Rated voltage	Ur	kV	7.2 to 17.5		
Phase distance		mm	145	185	240
Rated normal current	Ir	A	1250	1250	2500
Short-time withstand current (3 s)	Ik	kA	25	31.5	40
Making capacity		kA peak	2.5 Ik (50 Hz) & 2.6 Ik (60 Hz)		

Earthing truck

This device is a safety accessory used in place of the withdrawable circuit-breaker in order to earth the busbars.

Possibility of locking by padlocks in the service position.



Electrical characteristics

Rated voltage	Ur	kV rms	12	17.5	17.5
Phase distance		mm	145	185	240
Short-time withstand current (3 s)	Ik	kA	25	31.5	40
Making capacity		kA peak	2.5 Ik (50 Hz) & 2.6 Ik (60 Hz)		

Device



Phase to phase distance 145 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	630 A	165 kg
		1250 A	
12 kV	25 kA	630 A	
		1250 A	

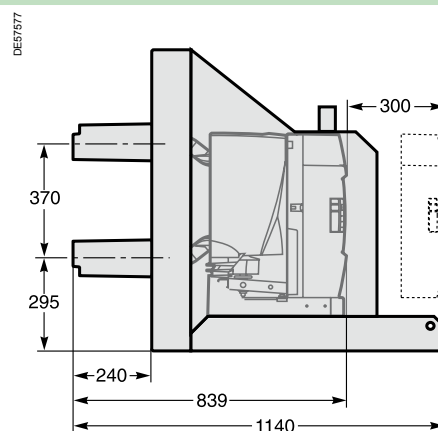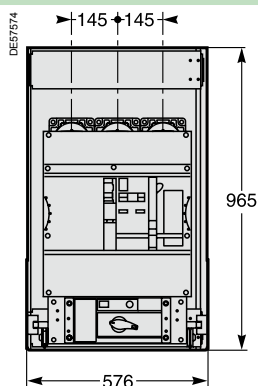



Phase to phase distance 185 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	630 A	174 kg
		1250 A	
12 kV	25 kA	630 A	
		1250 A	
17.5 kV	25 kA	630 A	
		1250 A	

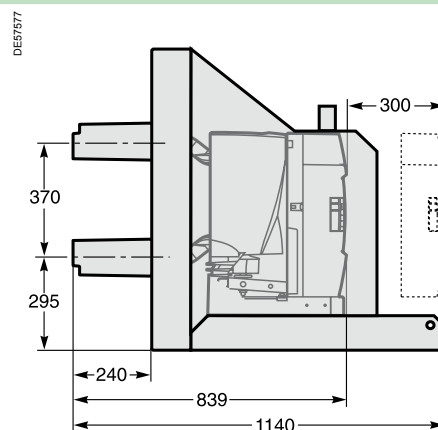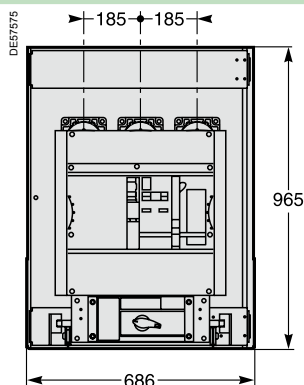

Phase to phase distance 240 mm

Ur	Isc	Ir	Weight
7.2 kV	25 kA	2500 A	272 kg
		5000 A	
12 kV	25 kA	2500 A	
		5000 A	
17.5 kV	25 kA	2500 A	
		5000 A	

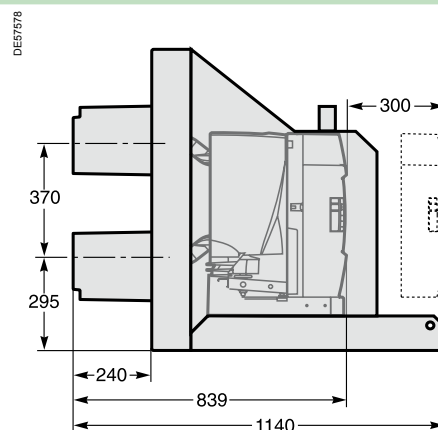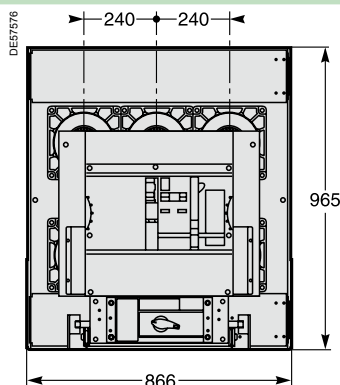

Important

Detailed installation instructions are given in the "Evolis Installation Guide". Please consult us.

Only one of the boxes (ticked ☒ or filled ☐ by the needed value) have to be considered between each horizontal line.

Green box ☒ corresponds to none priced functions.

Releases combinations table

MX1	1	1	1	1	1	1
MX2		1			1	
MN			1			1
Mitop				1	1	1

Basic withdrawable circuit breaker

Quantity

Rated voltage U_r	(kV)		
Short-circuit current I_{sc}	(kA)		
Rated current I_r	(A)		
Phase to phase distance (mm)	145 ☐	185 ☐	240 ☐
Colour for push buttons and indicators			
Push buttons open/closed:		Red/black	☒
Indicator open/closed:	Black/white	☒	Green/red
Operating mechanism charged/discharged:		Yellow/white	☒

Circuit breaker options

Opening release (see possible choices in combination table)

Shunt opening release **MX1**

24 Vac	☒	24...30 Vdc	☒	100...130 Vdc/ac	☒
48 Vac	☒	48...60 Vdc	☒	200...250 Vdc/ac	☒

Shunt opening release **MX2**

24 Vac	☐	24...30 Vdc	☐	100...130 Vdc/ac	☐
48 Vac	☐	48...60 Vdc	☐	200...250 Vdc/ac	☐

Undervoltage release **MN**

24 Vac	☐	24...30 Vdc	☐	100...130 Vdc/ac	☐
48 Vac	☐	48...60 Vdc	☐	200...250 Vdc/ac	☐

Time delay for **MN**

48...60 Vac	☐	100...130 Vdc/ac	☐	200...250 Vdc/ac	☐
-------------	--------------------------	------------------	--------------------------	------------------	--------------------------

Low energy release **Mitop**

☐

Remote control

Electrical motor **MCH**

24...30 Vdc	☐	100...125 Vdc	☐	200...250 Vdc	☐
48...60 Vdc/ac	☐	100...130 Vac	☐	200...240 Vac	☐

Shunt closing release **XF**

24 Vac	☒	24...30 Vdc	☒	100...130 Vdc/ac	☒
48 Vac	☒	48...60 Vdc	☒	200...250 Vdc/ac	☒

Module of 4 additional auxiliary contacts O/C 1 2

Ready to close contact PF

LV plug with interlocking 42-pin LV plug (instead of 18)

Operating shaft Quantity (one mini per switchboard)

Locking of the circuit breaker in the open position

By padlock	☐	Profalux	☒	Ronis	☒
or by locks and keys					
If locks	1 lock ☐	2 identical locks	☐	2 different locks	☐

Push buttons padlock of O/C circuit breaker

☐

Cradle









Quantity




Phase to phase distance (mm)	145 ☐	185 ☐	240 ☐
Bushings (6 per cradle)		630-1250 A	630-2500 A






Cradle accessories

Block of four position indication contacts: CB racked in/racked out	☐
One "CB ready to operate" indication contact	☐
Field deflectors for bushings	☐

The following components can be ordered separately and can be adapted or replaced by the customer.

Remote control and opening circuit			Ref.
MX1, MX2, XF shunt opening/closing release			
	24...30 Vdc	24 V 50/60 Hz	59284
	48...60 Vdc	48 V 50/60 Hz	59285
	100...130 Vdc - 50/60 Hz		59286
	200...250 Vdc - 50/60 Hz		59287
Undervoltage release MN			
	24...30 Vdc	24 V 50/60 Hz	59288
	48...60 Vdc	48 V 50/60 Hz	59289
	100...130 Vdc - 50/60 Hz		59290
	200...250 Vdc - 50/60 Hz		59291
Time delay for MN			
	48...60 Vdc - 50/60 Hz		33680
	100...130 Vdc - 50/60 Hz		33681
	200...250 Vdc - 50/60 Hz		33682
Low energy release Mitop			59160
			
Electrical motor MCH			
	24...30 Vdc		47888
	48...60 Vdc		47889
	100...125 Vdc		47890
	200...250 Vdc		47891
	48...60 V - 50/60 Hz		47889
	100...130 V - 50/60 Hz		47893
	200...240 V - 50/60 Hz		47894
Additional auxiliary contacts O/C			
	Module of 4 contacts		47887
LV terminal blocks			
	1 terminal block		47074
Ready to close contact PF			47080
			
Operation counter CDM			48535
			

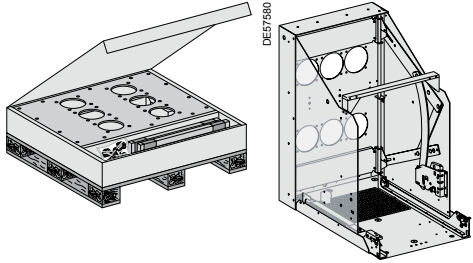Cradle		Ref.
Cradle without bushings (delivered in kit)		
	Phase to phase distance 145 mm	59316
	Phase to phase distance 185 mm	59317
	Phase to phase distance 240 mm	59318
Bushings		
	1 full bushing 630-1250 A	59382
	1 full bushing 630-2500 A	59383
	(you need at least 6 bushings per cradle)	
Field deflectors for bushings		
	6 deflectors used to increase dielectric withstand from 75 to 95 kV	59283
Indication of the "CB racked in/racked out" position		
	Module of 4 contacts	59173
Indication of "CB ready to operate"		
	C.B. "ready to be operated" PAF (1 AC) (indicates that the C.B. is locked in place in the cradle)	59174
Racking base		
	2 rails	59299

MV and LV connection accessories				Ref.
	LV plug			
	Standard 18 pins WITH interlocking			59114
	Standard 42 pins WITH interlocking			59115
LV wiring and ducting				
	Flexible conduct for LV wiring			59099
	LV connecting kit 42 wires			AAA10 087
Other accessories				Ref.
Earthing device				
	Earthing sliding contact on C.B.			59456
Labels kit for push button and indicator (O/C)				
	Circuit breaker specific labels green, red.			59100
Circuit breaker opening external device				
	Adaptation kit needed for circuit breaker opening (for retrofit)			59093
Various				Ref.
Disconnecting truck				
	Phase to phase distance Ur		Ir	Ith
	145 mm	7.2-17.5 kV	1250 A	25 kA
	185 mm	7.2-17.5 kV	1250 A	31.5 kA
	240 mm	7.2-17.5 kV	2500 A	40 kA
Earthing truck				
	Phase to phase distance Ur		Ir	Ith
	145 mm	7.2-17.5 kV	1250 A	31.5 kA
	185 mm	7.2-17.5 kV	1250 A	31.5 kA
	240 mm	7.2-17.5 kV	2500 A	40 kA
Rack-in/rack-out operation				
	Operating shaft			59449
Technical documentation				
	User manual			59069

The following components can only be adapted or replaced on site by staff trained by Schneider Electric

- Remote control mechanism (comprising: electrical motor, shunt closing release, operation counter)
- Operation counter
- Low energy release (Mitop)
- Interlocking between the “open” circuit breaker position and the LV plug
- Racking truck
- Circuit breaker front cover.

Presentation	55
Main characteristics	56
Description of functions	58
Racking in	58
MV and LV connection	60
P2 stored energy operating mechanism	61
Wiring diagram	61
Opening circuit	62
Remote control	64
Indication	65
Interlocking	66
Safety functions	67
Dimensions	68
Order form	69
Offer structure	70
Separated components	70
Services	72



PE58089



*Evolis circuit breaker 17,5 kV
withdrawable version in MC cassette*

Description of the device

The basic withdrawable version of the Evolis circuit breaker comprises:

- the circuit breaker unit with its operating mechanism:
 - three poles equipped with a vacuum interrupter
 - a P2 type, spring-operated stored energy control mechanism, electrifiable.This gives the device an opening and closing speed that is independent of the operator, for both electrical and manual orders. It enables reclosing cycles to be carried out
- a front panel housing the manual operating mechanism and status indicators.
- the components enabling it to be withdrawable:
 - the circuit breaker is equipped with racking arms and contact fingers and mounted on a racking in/out drive device with a threaded shaft activated by a handle, including all of the safety interlock systems.
 - a Harting type male LV connector allows connection of the external auxiliary circuits.

Each device can optionally be fitted with:

- locking of the circuit breaker in the following positions:
 - open, by a key lock installed on the control panel
 - racked out, by a key lock installed on the drive device.
- the basic MC cassette, comprising:
 - a metal structure and two guide rails
 - fixed connection fingers insulated by bushings
 - metal shutters to insulate from the HV part
 - safety interlocking systems
 - a female Harting type LV connector.
- MC cassette options:
 - circuit breaker racked-in or out position indicator contacts
 - a circuit breaker operating mechanism spring discharge system
 - a circuit breaker racked-in blocking mechanism
 - an extraction tool
 - an equipped door
 - a foolproof device for the circuit breaker rating.

Applications

Evolis circuit breakers are three-pole indoor MV circuit breakers. They are mainly used for operation and protection of public, industrial and tertiary distribution networks from 7.2 to 17.5 kV.



Electrical characteristics according to IEC 62271-100

Phase to phase		mm	145			
Cassette type			MC1			
Rated voltage	Ur	kV 50/60 Hz	7.2	12		
Insulation level						
- power frequency withstand	Ud	kV 50 Hz 1 min ⁽¹⁾	20	28		
- lightning impulse withstand	Up	kV peak	60	75		
Rated current	Ir	A	630	■	■	■
		1250	■	■	■	■
		2500	—	—	—	—
Short circuit current	Isc	kA	25	31.5	25	31.5
Short time withstand current	Ikt/tk	kA/3 s	25	31.5	25	31.5
Short-circuit making current	Ip	kA peak	50 Hz	63	79	63
		60 Hz	65	82	65	82

Common characteristics according to IEC 62271-100

Rated switching sequence	O-3 min-CO-3 min-CO	■
	O-0.3 s-CO-3 min-CO	■
	O-0.3 s-CO-15 s-CO	■
Operating times	Opening	< 50 ms
	Breaking	< 60 ms
	Closing	< 65 ms
Service temperature	T	°C
Mechanical endurance	Class	M1 ⁽²⁾ - M2
	Number of switching operations	2000 ⁽²⁾ - 10 000
Electrical endurance	Class	E2
Number of switching operations at full Isc value	25 kA	100
	31.5 kA	50
	40 kA	30
Capacitive current breaking capacity	Class	C1
Average relative humidity	Over 24 h	< 95%
	Over 1 month	< 90%

Switching and protection of capacitor banks

Evolis range circuit breakers are well suited for switching and protection of capacitor banks with installed power up to 2 Mvar installed in series with dampening reactor limiting inrush current to 2 kA.

Evolis is also well suited for capacitor banks system with installed power higher than 2 Mvar in conjunction with anti-harmonic filtering system.


Please consult us.

185									240								
MC2									MC3								
7.2			12			17.5			7.2			12			17.5		
20			28			38			20			28			38		
60			75			95			60			75			95		
–	■	■	–	■	■	■	■	–	–	■	–	–	■	–	–	–	
–	■	■	–	■	■	■	■	–	–	■	–	–	■	–	–	■	
–	–	–	–	–	–	–	–	■	■	■	■	■	■	■	■	■	
25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	25	31.5	40 ⁽²⁾	
25	31.5	40	25	31.5	40	25	31.5	25	31.5	40	25	31.5	40	25	31.5	40	
63	79	100	63	79	100	63	79	63	79	100	63	79	100	63	79	100	
65	82	104	65	82	104	65	82	65	82	104	65	82	104	65	82	104	

(1) Circuit breaker tested at Ud 42 kV 50 Hz, 1 min

(2) Class M1: 2000 operations for I_{sc} = 40 kA

■ Available
– Not available.

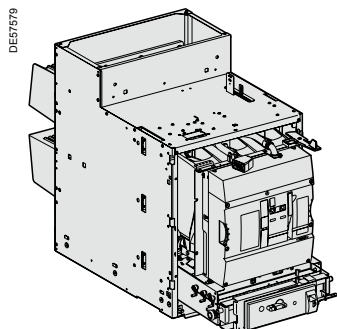

Assembly components


The "racking-in/out" function is achieved by:

- the withdrawable circuit breaker with its LV connector (mobile part)
- the cassette with its bushings (fixed part).


Circuit breaker operation

The withdrawable circuit breaker can be placed in 3 stable positions:


- **service position:** circuit breaker racked in and locked in position;
LV plugs connected
- **test position:** circuit breaker racked out and locked in position;
LV plug connected
- **disconnected position:** circuit breaker extracted and locked in this position,
LV plug disconnected.



Operating position



Test position



Disconnected position

Circuit breaker safety functions

A drive system using a threaded shaft gives easier racking and unracking.

Test position contact

This is activated when the circuit breaker is in the "test" or "service" position.

Earthing is achieved throughout the operation via the racking carriage casters. An addition earthing system can be supplied as an option.

Interlocking mechanisms

In conformity with IEC standards 62271-100 and 62271-200, the following interlocks are available:


- impossibility of racking in or out if the circuit breaker is not in the "open" position
- impossible to rack in the circuit breaker when the LV plug is not connected
- impossible to disconnect the LV plug if the circuit breaker is not racked-out.

Cubicle door interlocking mechanism



The carriage is equipped with a device that enables interlocking between the racking out of the circuit breaker and the cubicle door:

- possible to rack in the circuit breaker only if the door is closed
- possible to open the door only if the circuit breaker is racked out.


This device must be disabled if the interlocking function is not present.

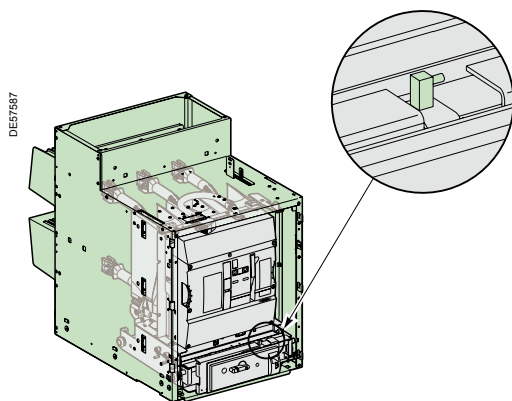


Interlocking door-cubicle

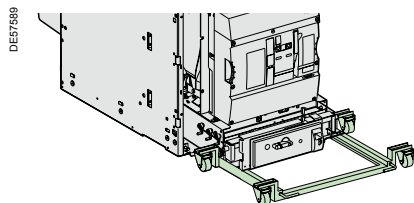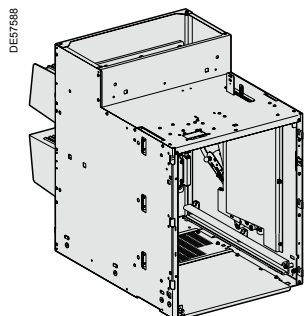


Extraction tool

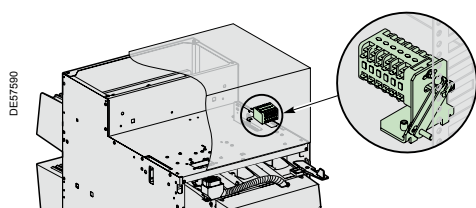

Indication contacts

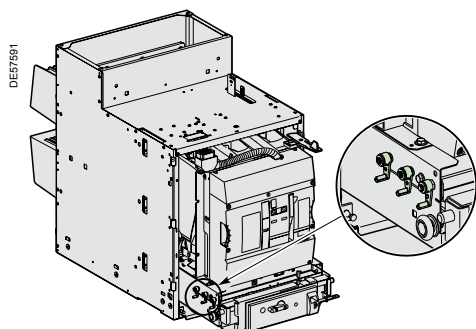

Discharge of the circuit breaker operating mechanism on extraction

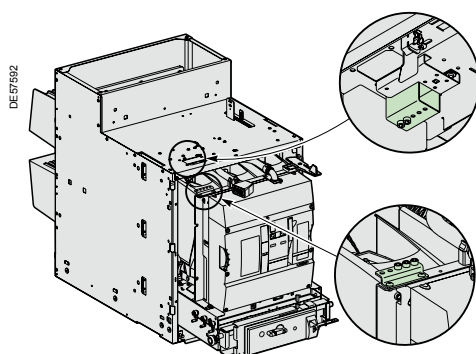

Cassette/circuit breaker foolproofing device

MC cassette safety functions

The MC cassette is designed to receive the Evolis circuit breaker and comprises the following components ensuring safety when racking-in (see details in the *Installation Guide ref. 07897536EN*).

Metal structure with two guide rails

The rails guide the Evolis circuit breaker during racking-in/out operations.

Fixed connection fingers insulated by bushings

The three ends of the circuit breaker, fitted with racking clusters, provide the contact with these three fingers.

Metal shutters to insulate from the MV part

Three shutters mounted on the structure stop access to the racking fingers when the circuit breaker is extracted (protection index: IP2X).

Safety interlocking systems

When carrying out maintenance operations, it is possible to:

- padlock the shutters in the closed position
- unlock the access mechanism to the fixed contacts.

Anti-drop function

This function ensures operator safety during circuit breaker extraction.

Compulsory MC cassette accessories

Female Harting low voltage connector

A connector with a cable can either be delivered with the circuit breaker, with the circuit breaker plus the cassette, or separately.

Panel with circuit breaker operation pictograms

A self-adhesive panel shows racking-in and out operations for the circuit breaker. This is systematically delivered when the circuit breaker is ordered either with the cassette or as a separate order.

Racking handle

The handle is used for circuit breaker racking-in/out operations and for earthing switch opening and closing operations.

Extraction tool

- A standard tool allows the breaking device to be extracted from each cassette version, whatever the installation height, up to 800 mm from the ground.
- A simplified extraction tool can be manufactured locally according to the installation height.

MC cassette options

Circuit breaker racked-in or racked-out position indicator contacts

6 contacts (3 NO + 3 NC) or 12 contacts (6 NO + 6 NC)

Operating mechanism spring discharge system

Circuit breaker operating mechanism springs are automatically discharged when it is extracted from the cubicle. This function avoids any risk of unwanted circuit breaker closing.

Mechanical circuit breaker racked-in lock

This option is included when the earthing switch is installed. However, it can be delivered separately if the earthing circuit breaker is not required: it takes the space and volume of the earthing switch operating mechanism.

Equipped MV access door

Possibility of delivering a fully equipped, painted door (RAL 9001) available with or without the manual circuit breaker closing mechanism.


Possibility of producing the door locally (drawings and accessories available).

Foolproofing device

This enables foolproofing of the circuit breaker rating relative to the cassette rating. This system is mounted on the cassette side. The corresponding combining of the right circuit breaker rating must be carried out by the panel builder.

MV connection

The customer connection is easily made at the rear of the cassette on the connection terminals integrated in the bushings (see drilling details in the "Installation Guide" ref. 07897536EN).

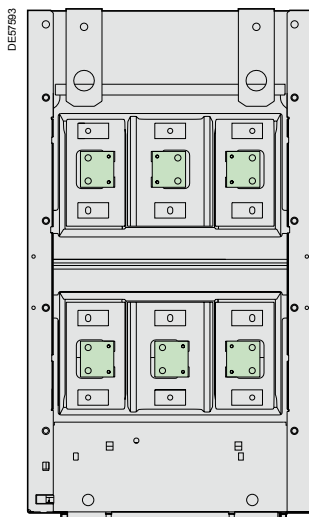

MV connection

LV connection


With the withdrawable circuit breaker, the LV cabling has an LV connector with:

- a mobile part (male Harting connector) at the end of a flexible cable, fully connected to the operating mechanism terminal by a sleeve
- a fixed part (female Harting connector) compatible with the male part mounted at the top, inside the cassette.

Interlocking function

In conformity with IEC standard 62271-200, an interlocking function prohibits:

- racking in when the LV plug is not connected
- disconnection of the LV plug if the circuit breaker is in the racked-in position.

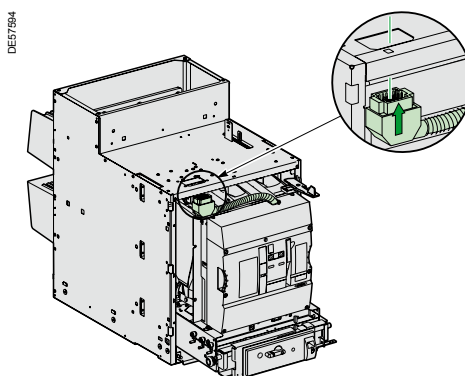

LV plug connection

Description of functions

P2 stored energy operating mechanism

Wiring diagram

PE56600



Operation of the P2 stored energy operating mechanism


This gives the device an opening and closing speed that is independent of the operator whether the order is electrical or manual.


The electrical control mechanism carries out reclosing cycles and is automatically recharged by a geared motor each time after closing.

It consists of:


- the stored energy operating mechanism which stores in springs the energy required to open and close the device
- a gear motor electrical charging device with manual charging by lever (useful on loss of auxiliary supply)
- manual order devices by push buttons on the front panel of the device
- an electrical remote closing device containing a release with an antipumping relay
- an electrical opening device containing one or more releases, for example:
 - shunt opening
 - undervoltage
 - Mitop, a low consumption release, used only with the Sepam 100 LA protection relay.
- an operation counter
- a position indication device by mechanical indicator and 3 modules of 4 auxiliary contacts whose availability varies according to the diagram used
- a device for indicating "charged" operating mechanism status by mechanical indicator and electrical contact.

Wiring diagram (principle)

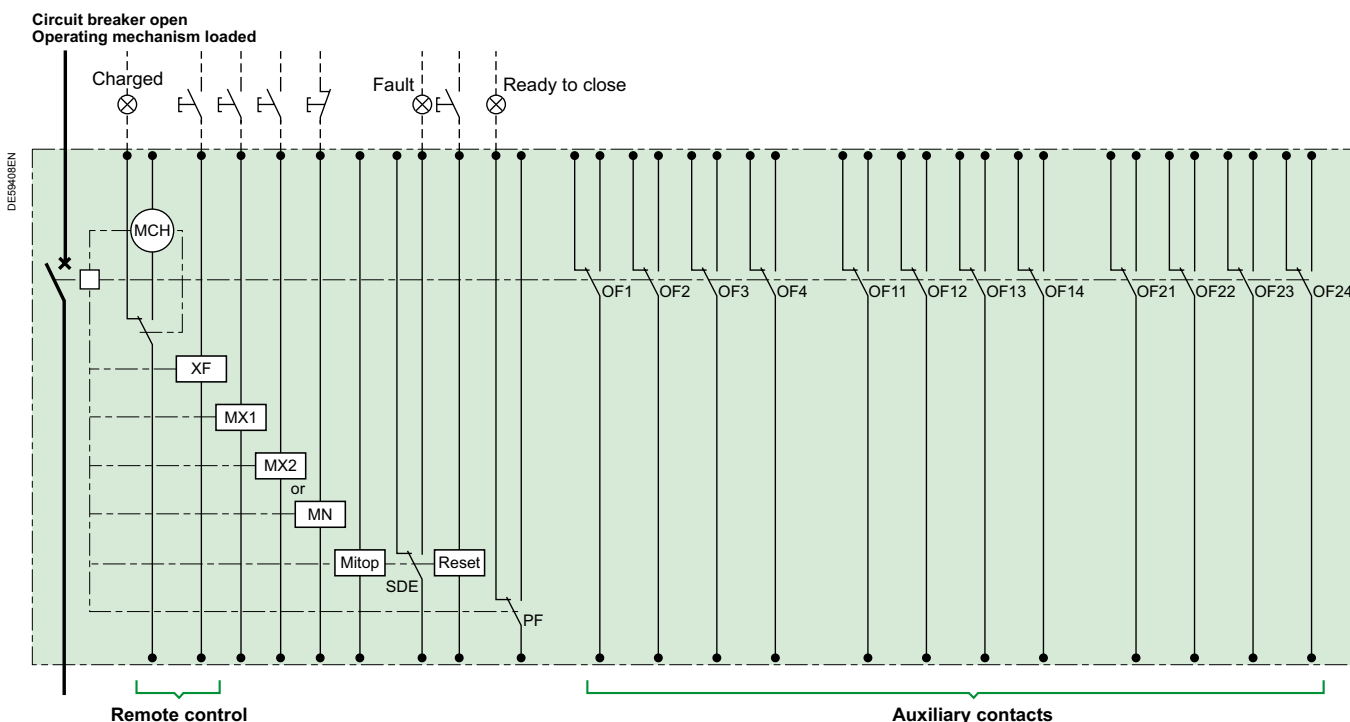

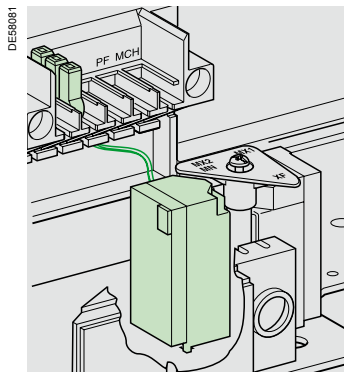

Circuit breaker equipped with
a shunt opening release MX



Shunt opening release (MX1 and MX2)

Composition

The opening circuit is produced using the following components:

- a shunt opening release (MX1)
 - a second shunt opening release (MX2)
 - undervoltage release (MN)
 - time delayed undervoltage release (MNR: MN + time delay).
- The time delay, placed outside the circuit breaker, can be disabled by an emergency stop button to give instant circuit breaker opening.

- low energy release (Mitop).

Note: see the table of the releases' combinations on the following page.


Shunt opening release (MX1 and MX2)

Energizing this release causes instant opening of the circuit breaker.


Permanent power supply to the MX unit locks the circuit breaker in the "open" position.

Characteristics


Power supply	See "Order form" page	
Threshold	0.7 to 1.1 Ur	
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Undervoltage release (MN)



Time delay for undervoltage release (MN)

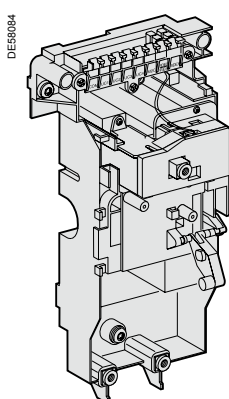

Low energy release (Mitop)

Undervoltage release (MN)

This release unit causes the systematic opening of the circuit breaker when its supply voltage drops below a value less than 35% of the rated voltage, even if this drop is slow and gradual. It can open the circuit breaker between 35% and 70% of its rated voltage. If the release unit is not supplied power, manual or electrical closing of the circuit breaker is impossible. Closing of the circuit breaker is possible when the supply voltage of the release unit reaches 85% of its rated voltage.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5

Time delay for MN

To eliminate spurious tripping of the circuit breaker when there are brief voltage drops, the MN action is controlled with a time delay. This function is achieved by adding a time delay unit outside of the undervoltage release (MN) circuit (adjustable time delay). This unit is placed outside the circuit breaker and can be inhibited by an emergency stop button to obtain instant circuit breaker opening.

Characteristics

Power supply	See "Order form" page	
Threshold	Opening	0.35 to 0.7 Ur
	Closing	0.85 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5
Time delay	0.5 s - 0.9 s - 1.5 s - 3 s	

Low energy release (Mitop)

This release includes a low consumption unit and is specifically used with the Sepam 100LA self-powered unit ("REFLEX MODULE"), or the VIP relay.

Characteristics

Power supply	Direct current
Threshold	$0.6 A < I < 3 A$

Any tripping due to the Mitop release unit is momentarily indicated by an SDE type changeover contact, provided with the Mitop.


This release also includes a coil (reset) enabling remote SDE contact reset.

Comment:

Use of the Mitop low energy release requires adjustment of the protection relay time delay in order to ensure that the circuit breaker trips between 45-50 ms.

Releases combinations table

Shunt opening MX1	1	1	1	1	1	1
Shunt opening MX2		1			1	
Undervoltage MN			1			1
Mitop				1	1	1

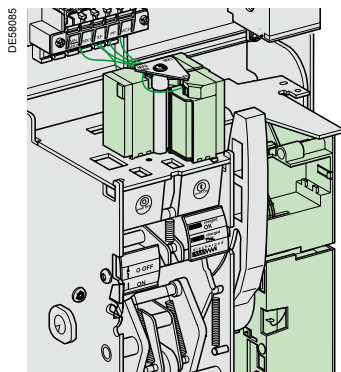

Circuit breaker equipped with remote control

Function

Remote control enables the remote opening and closing of the circuit breaker.

The opening order always takes priority over the closing order.

In the event of simultaneous opening and closing orders, the mechanism discharges under no load, without moving the main contacts. The circuit breaker remains in the "open" position.


In the event of latched opening and closing orders, the mechanism carries out anti-pumping function as standard, by blocking the circuit breaker in the "open" position.

Anti-pumping function: after opening on a fault or deliberate opening via the manual or electrical mechanism, the closing order must be interrupted then reactivated to enable reclosing of the circuit breaker.

Composition

The remote control comprises:

- an electrical motor (MCH) equipped with a "spring armed" CH limit switch
- a shunt closing release (XF).



Electrical motor MCH

Electrical motor (MCH)


The electrical motor carries out the automatic rearming of the storage energy springs as soon as the circuit breaker closes. This allows instant reclosing of the device after opening. The arming lever is only used as a backup control in the case of the absence of the auxiliary power supply.

An electrical motor (MCH) equipped with a "spring armed" CH limit switch.

This contact indicates the "armed" position of the mechanism (springs armed).

Characteristics

Power supply	See "Order form" page	
Threshold	0.85 to 1.1 Ur	
Consumption (VA or W)	180	
Motor overcurrent	2 to 3 In for 0.1 s	
Arming time	6 s maximum	
Operating rate	3 cycles maximum per minute	
CH contact	10 A/240 V	




Shunt closing release XF

Shunt closing release (XF)

This release allows remote closing of the circuit breaker when the control mechanism is armed. It can be permanently or briefly supplied power.

Characteristics XF

Power supply	See "Order form" page	
Threshold	XF	0.85 to 1.1 Ur
Consumption (VA or W)	Triggering	200 (for 200 ms)
	Latched	4.5



Rotary type contacts (OC)

“Open/closed” auxiliary position contacts (OC)

These auxiliary contacts indicate the “open” or “closed” position of the circuit breaker.

■ Rotary type changeover contacts directly controlled by the circuit breaker mechanism.

■ Indicator contacts are proposed:

□ for standard relaying applications


□ for low level control applications with plc's or electronic circuits.

This version is compatible with Sepam series 20-40-80 units.

Characteristics

Standard delivery	4		
Maximum quantity	12		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	10/6 *
		480	10/6 *
		690	6
	V DC	24/48	10/6 *
		125	10/6 *
		250	3
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	6
		240	6
		380	3
	V DC	24/48	6
		125	6
		250	3

* Standard contacts: 10 A; optional contacts: 6 A (temperature derating)



“Ready to close” PF contact

“Ready to close” PF contact

The circuit breaker is “ready to close” when shown by a mechanical indicator and a PF changeover contact.

This information simultaneously indicates that:

■ the circuit breaker is open

■ the storage energy springs are armed

■ there is no permanent closing order


■ there is no permanent opening order caused by:

□ a safety opening order (2nd MX or MN)

□ keylocking of the device in the open position.

Characteristics

Standard delivery	0		
Maximum quantity	1		
Breaking capacity (A)	Standard	Min. load: 100 mA/24 V	
Cos φ: 0.3 CA12/DC12	V AC	240/380	5
		480	5
		690	3
	V DC	24/48	3
		125	0.3
		250	0.15
	Low level		Min. load: 2 mA/15 V DC
	V AC	24/48	3
		240	3
		380	3
	V DC	24/48	3
		125	0.3
		250	0.15




Operation counter (CDM)

Operation counter (CDM)

The operation counter is visible on the front panel.

It totalizes the number of switching cycles (CO) that the device has carried out.

DE57587

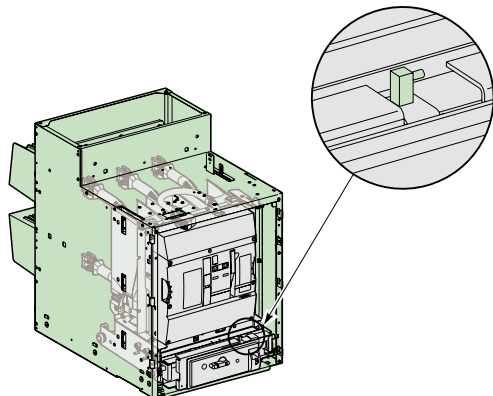

Cubicle door interlocking mechanism

Cubicle door interlocking mechanism

This device enables the circuit breaker to only be operated when the door is closed, for the withdrawable version with a cradle.

Description of functions




Safety functions

This table describes the safety functions available on the withdrawable version of the Evolis 17.5 kV circuit breaker.

How to use the table

Each of the boxes describes the functional status of each circuit breaker position and the associated parts:

-  Possible status
-  Possible status, impossible operation
-  Impossible status

Parts		Circuit breaker positions					
			Insertion -----> <----- Extraction			Racking-in -----> <----- Racking-out	
		Removed		Disconnected	Test position		Service
1 - Cassette			Fool-proof protection ⁽¹⁾ Anti-drop ⁽²⁾				
		No opening shutters					
		Shutters padlocking possible					
2 - LV plug	Disconnected			No door closing			
	Connected				No unplugging		
3 - Circuit breaker	Closed				No racking-in		No racking-out
	Open					No closing	
		Open position circuit breaker locking available					
4 - Switchboard door	Open				No racking-in		
	Closed				No door opening ⁽³⁾		
5 - Earthing switch	Open					No earthing switch closing	
	Closed				No racking-in		

⁽¹⁾ This protection mechanism ensures that the performance levels of the circuit breaker correspond with those of the cassette.


⁽²⁾ Device that prevents the circuit breaker from dropping when extracted from the cassette.

The device can be either unlocked manually or when the extraction rig is put in position.

⁽³⁾ Interlocking device to be fitted to the cubicle door. If there is no interlocking, the circuit breaker device should be inhibited.

Device
Basic withdrawable

Cassette		MC1	MC2	MC3
Phase to phase (mm)	E	145	185	240
Dimensions (mm)	W	556	686	886
	H	980	980	980
	D	1223	1223	1223
Weight (kg)		222	255	326

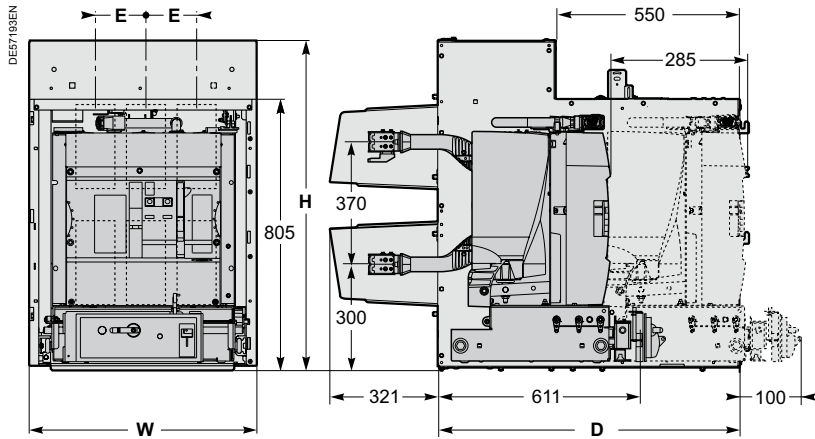

Only one of the boxes (ticked ☒ or filled ☐ by the needed value) have to be considered between each horizontal line.

Green box ☒ corresponds to none priced functions.

Releases combinations table

MX1	1	1	1	1	1	1
MX2		1			1	
MN			1			1
Mitop				1	1	1

Basic withdrawable circuit breaker

Quantity

Rated voltage U_r	(kV)		
Short-circuit current I_{sc}	(kA)		
Rated current I_r	(A)		
Phase to phase distance (mm)	145 ☐	185 ☐	240 ☐
Colour for push buttons and indicators			
Push buttons open/closed:		Red/black	☒
Indicator open/closed:	Black/white ☒	Green/red	☐
Operating mechanism charged/discharged:		Yellow/white	☒

Circuit breaker options

Opening release (see possible choices in combination table)

Shunt opening release **MX1**

24 Vac ☒	24...30 Vdc ☒	100...130 Vdc/ac ☒
48 Vac ☒	48...60 Vdc ☒	200...250 Vdc/ac ☒

Shunt opening release **MX2**

24 Vac ☐	24...30 Vdc ☐	100...130 Vdc/ac ☐
48 Vac ☐	48...60 Vdc ☐	200...250 Vdc/ac ☐

Undervoltage release **MN**

24 Vac ☐	24...30 Vdc ☐	100...130 Vdc/ac ☐
48 Vac ☐	48...60 Vdc ☐	200...250 Vdc/ac ☐

Time delay for **MN**

48...60 Vac ☐	100...130 Vdc/ac ☐	200...250 Vdc/ac ☐
--------------------------------------	---	---

Low energy release **Mitop**

☐

Remote control

Electrical motor **MCH**

24...30 Vdc ☐	100...125 Vdc ☐	200...250 Vdc ☐
48...60 Vdc/ac ☐	100...130 Vac ☐	200...240 Vac ☐

Shunt closing release **XF**

24 Vac ☒	24...30 Vdc ☒	100...130 Vdc/ac ☒
48 Vac ☒	48...60 Vdc ☒	200...250 Vdc/ac ☒

Module of 4 additional auxiliary contacts O/C	1 ☐	2 ☐
Ready to close contact PF	☐	
LV plug	42-pin LV plug (instead of 18) ☐	
Operating shaft	Quantity (one mini per switchboard)	

MC cassette






Quantity



MC cassette type	MC1 ☐	MC2 ☐	MC3 ☐
Short-circuit current I_{sc}	≤ 40 kA ☐		
Rated current I_r	1250 A ☐	2500 A ☐	

MC cassette accessories

Racked in/out position contact	3 NO, 3 NC ☐	6 NO, 6 NC ☐	
Pictogram	of the circuit breaker ☐	of the earthing sw. ☐	
Discharge of the circuit breaker control mechanism springs ☐			
Extraction table	Quantity		
Extra handle	Quantity		
Door with handle, windows and pictogram			
	MC1 ☐	MC2 ☐	MC3 ☐
Door accessories (local manufacture): handle, windows and pictogram			
with cover plate for	MC1 ☐	MC2 ☐	MC3 ☐

The following components can be ordered separately and can be adapted or replaced by the customer.

Remote control and opening circuit			Ref.
MX1, MX2, XF shunt opening/closing release			
	24...30 Vdc	24 V 50/60 Hz	59284
	48...60 Vdc	48 V 50/60 Hz	59285
	100...130 Vdc - 50/60 Hz		59286
	200...250 Vdc - 50/60 Hz		59287
Undervoltage release MN			
	24...30 Vdc	24 V 50/60 Hz	59288
	48...60 Vdc	48 V 50/60 Hz	59289
	100...130 Vdc - 50/60 Hz		59290
	200...250 Vdc - 50/60 Hz		59291
Time delay for MN			
	48...60 Vdc - 50/60 Hz		33680
	100...130 Vdc - 50/60 Hz		33681
	200...250 Vdc - 50/60 Hz		33682
Low energy release Mitop			
			59160
Electrical motor MCH			
	24...30 Vdc		47888
	48...60 Vdc		47889
	100...125 Vdc		47890
	200...250 Vdc		47891
	48...60 V - 50/60 Hz		47889
	100...130 V - 50/60 Hz		47893
Additional auxiliary contacts O/C			
	Module of 4 contacts		47887
LV terminal blocks			
	1 terminal block		47074
Ready to close contact PF			
			47080

Accessories		Ref.
MC cassette		
	MC1	51237324FR
	MC2	51237324FQ
	MC3 (Ir up to 1250 A)	51237324FW
	MC3 (Ir > 1250 A)	51237324FS
Indication of the "CB racked in/racked out" position		
	Module of 6 contacts	AAA12951FA
	Module of 12 contacts	AAA12951FB
Rack-in/rack-out operation		
	Operating shaft	03405140FO

The following components can only be adapted or replaced on site by staff trained by Schneider Electric

- Remote control mechanism (comprising: electrical motor, shunt closing release, operation counter)
- Operation counter
- Low energy release (Mitop)
- Interlocking between the “open” circuit breaker position and the LV plug
- Racking truck
- Circuit breaker front cover.

Presentation	74
Main characteristics	75
Description of functions	76
Racking in	76
MV and LV connection	78
RI stored energy operating mechanism	79
Wiring diagram	79
Opening circuit	80
Remote control	81
Indication	82
Safety functions	83
Dimensions	84
Order form	85
Offer structure	86
Separated components	86
Services	87

PEE56545



*Evolis HP circuit breaker
withdrawable version in MC cassette*

Description of the device

The basic withdrawable version of the Evolis HP circuit breaker comprises:

- the circuit breaker unit with its operating mechanism:
 - three poles equipped with a vacuum interrupter
 - an RI stored energy electrical operating mechanism.
- This gives the device an opening and closing speed that is independent of the operator, for both electrical and manual orders. It enables reclosing cycles to be carried out
- a front panel housing the manual operating mechanism and status indicators.
- the components enabling it to be withdrawable:
 - the circuit breaker is equipped with racking arms and contact fingers and mounted on a racking in/out drive device with a threaded shaft activated by a handle, including all of the safety interlock systems.
 - a Harting type male LV connector allows connection of the external auxiliary circuits.

Each device can optionally be fitted with:

- locking of the circuit breaker in the following positions:
 - open, by a key lock installed on the control panel
 - racked out, by a key lock installed on the drive device.
- the basic MC cassette, comprising:
 - a metal structure and two guide rails
 - fixed connection fingers insulated by bushings
 - metal shutters to insulate from the HV part
 - safety interlocking systems
 - a female Harting type LV connector.
- MC cassette options:
 - circuit breaker racked-in or out position indicator contacts
 - a circuit breaker operating mechanism spring discharge system
 - a circuit breaker racked-in blocking mechanism
 - an extraction tool
 - an equipped door
 - a foolproof device for the circuit breaker rating.

Applications

Evolis circuit breakers are three-pole indoor MV circuit breakers. They are mainly used for operation and protection of public, industrial and tertiary distribution networks from 7.2 to 15 kV.

Electrical characteristics according to IEC 62271-100

Phase to phase				240															
Cassette type				MC3															
Rated voltage	Ur	kV 50/60 Hz		7.2				12				15							
Insulation level																			
- power frequency withstand	Ud	kV 50 Hz 1 min		20				28				38							
- lightning impulse withstand	Up	kV peak		60				75				95							
Rated current	Ir	A	1250	—	—	—	—	—	—	—	■	—	—	—	■				
			2500	—	—	—	■	—	—	—	■	—	—	—	■				
			3150	■	■	■	■	■	■	■	■	■	■	■	■				
Short circuit current	Isc	kA	25	31.5	40	50	25	31.5	40	50	25	31.5	40	50					
Short time withstand current	Ik/tk	kA/3 s	25	31.5	40	50	25	31.5	40	50	25	31.5	40	50					
Short-circuit making current	Ip	kA peak	50 Hz	63	79	100	125	63	79	100	125 (*)	63	79	100	125 (*)				
			60 Hz	65	82	104	130	65	82	104	130 (*)	65	82	104	130 (*)				


Common characteristics according to IEC 62271-100

Rated switching sequence	O-3 min-CO-3 min-CO	■
	O-0.3 s-CO-3 min-CO	■
	O-0.3 s-CO-15 s-CO	■
Operating times	Opening ms	< 52
	Breaking ms	< 73
	Closing ms	< 61
Service temperature	T °C	– 5 to + 40
Mechanical endurance	Class	M2
	Number of operations	10 000
Electrical endurance	Class	E2
Number of switching operations at full Isc value	25 kA	100
	31.5 kA	50
	40 kA	30
	50 kA	30
Capacitive current breaking capacity	Class	C1
Average relative humidity	Over 24 h	< 95%
	Over 1 month	< 90%

■ Available

– Not available.

(*) 150 kA available on request.

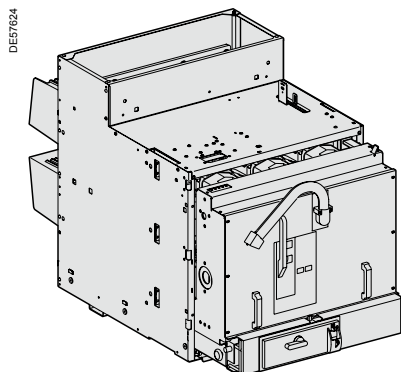

Assembly components


The "racking-in/out" function is achieved by:

- the withdrawable circuit breaker with its LV connector (mobile part)
- the cassette with its bushings (fixed part).


Circuit breaker operation

The withdrawable circuit breaker can be placed in 3 stable positions:


- **service position:** circuit breaker racked in and locked in position;
LV plugs connected
- **test position:** circuit breaker racked out and locked in position;
LV plug connected
- **disconnected position:** circuit breaker extracted and locked in this position,
LV plug disconnected.



Operation position



Test position



Disconnected position

Circuit breaker safety functions

A drive system using a threaded shaft gives easier racking and unracking.

Test position contact

This is activated when the circuit breaker is in the "test" or "service" position.

Earthing is achieved throughout the operation via the racking carriage casters. An addition earthing system can be supplied as an option.

Interlocking mechanisms

In conformity with IEC standards 62271-100 and 62271-200, the following interlocks are available:


- impossibility of racking in or out if the circuit breaker is not in the "open" position
- impossible to rack in the circuit breaker when the LV plug is not connected
- impossible to disconnect the LV plug if the circuit breaker is not racked-out.

Cubicle door interlocking mechanism


The carriage is equipped with a device that enables interlocking between the racking out of the circuit breaker and the cubicle door:

- possible to rack in the circuit breaker only if the door is closed
- possible to open the door only if the circuit breaker is racked out.

This device must be disabled if the interlocking function is not present.

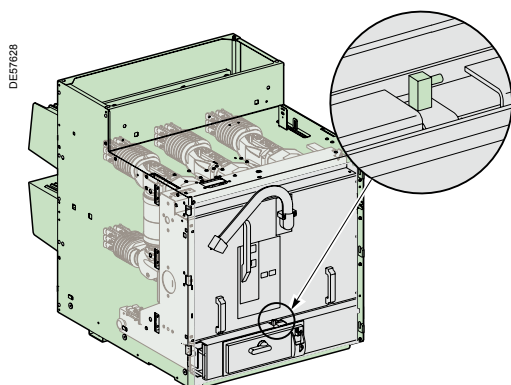

Interlocking door-cubicle

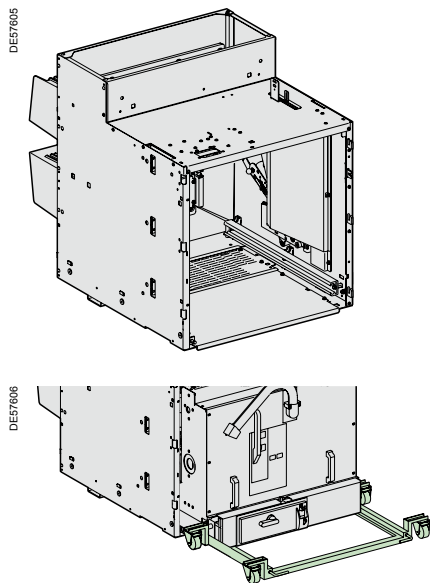

MC cassette safety functions

The MC cassette is designed to receive the Evolis circuit breaker and comprises the following components ensuring safety when racking-in (see details in the *Installation Guide* ref. 07897536EN).

Metal structure with two guide rails

The rails guide the Evolis circuit breaker during racking-in/out operations.

Fixed connection fingers insulated by bushings

The three ends of the circuit breaker, fitted with racking clusters, provide the contact with these three fingers.

Metal shutters to insulate from the MV part

Three shutters mounted on the structure stop access to the racking fingers when the circuit breaker is extracted (protection index: IP2X).


Safety interlocking systems

When carrying out maintenance operations, it is possible to:


- padlock the shutters in the closed position
- unlock the access mechanism to the fixed contacts.

Anti-drop function


This function ensures operator safety during circuit breaker extraction.

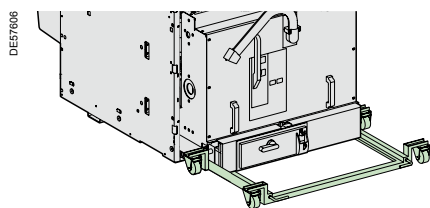


Extraction tool

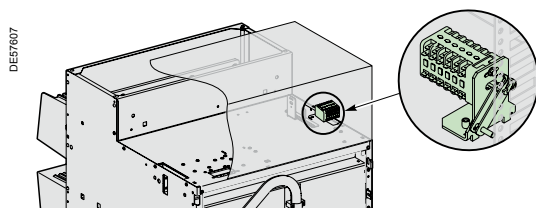

Indication contacts

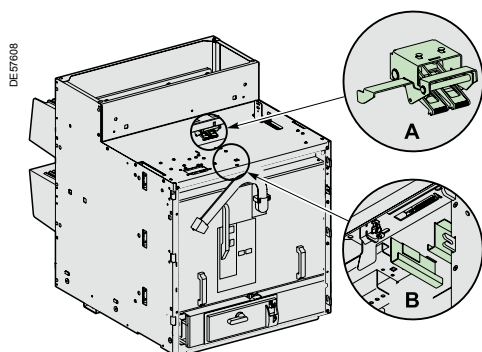

(A) 50 kA interlock
(B) Discharge of the circuit breaker operating mechanism on extraction

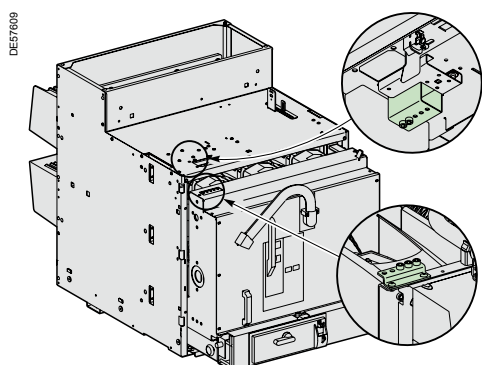

Cassette/circuit breaker foolproofing device

Compulsory MC cassette accessories

Female Harting low voltage connector

A connector with a cable can either be delivered with the circuit breaker, with the circuit breaker plus the cassette, or separately.

Panel with circuit breaker operation pictograms

A self-adhesive panel shows racking-in and out operations for the circuit breaker. This is systematically delivered when the circuit breaker is ordered either with the cassette or as a separate order.

Racking handle

The handle is used for circuit breaker racking-in/out operations and for earthing switch opening and closing operations.

Extraction tool

- A standard tool allows the breaking device to be extracted from each cassette version, whatever the installation height, up to 800 mm from the ground.
- A simplified extraction tool can be manufactured locally according to the installation height.

50 kA fixing lock

This upper lock enabling the circuit breaker to be held in the cassette in the case of a fault, is compulsory for a 50 kA withstand.

MC cassette options

Circuit breaker racked-in or racked-out position indicator contacts

6 contacts (3 NO + 3 NC) or 12 contacts (6 NO + 6 NC)

Operating mechanism spring discharge system

Circuit breaker operating mechanism springs are automatically discharged when it is extracted from the cubicle. This function avoids any risk of unwanted circuit breaker closing.

Mechanical circuit breaker racked-in lock

This option is included when the earthing switch is installed. However, it can be delivered separately if the earthing circuit breaker is not required: it takes the space and volume of the earthing switch operating mechanism.

Equipped MV access door

Possibility of delivering a fully equipped, painted door (RAL 9001) available with or without the manual circuit breaker closing mechanism.


Possibility of producing the door locally (drawings and accessories available).

Foolproofing device

This enables foolproofing of the circuit breaker rating relative to the cassette rating. This system is mounted on the cassette side. The corresponding combining of the right circuit breaker rating must be carried out by the panel builder.

MV connection

The customer connection is easily made at the rear of the cassette on the connection terminals integrated in the bushings (see drilling details in the "Installation Guide" ref. 07897536EN).

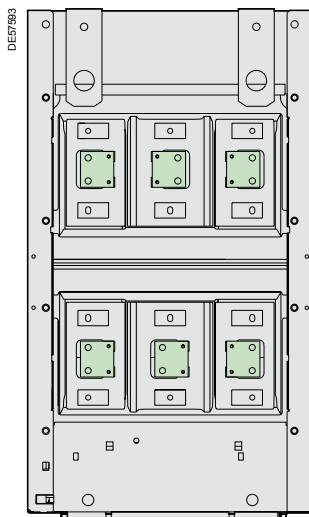

MV connection

LV connection


With the withdrawable circuit breaker, the LV cabling has an LV connector with:

- a mobile part (male Harting connector) at the end of a flexible cable, fully connected to the operating mechanism terminal by a sleeve
- a fixed part (female Harting connector) compatible with the male part mounted at the top, inside the cassette.

Interlocking function

In conformity with IEC standard 62271-200, an interlocking function prohibits:

- racking in when the LV plug is not connected
- disconnection of the LV plug if the circuit breaker is in the racked-in position.

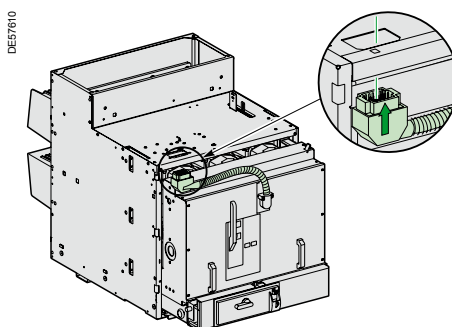

LV plug connection

Description of functions

RI stored energy operating mechanism

Wiring diagram

PEE7104



Operation of the RI stored energy operating mechanism


This gives the device an opening and closing speed that is independent of the operator whether the order is electrical or manual.


The electrical control mechanism carries out reclosing cycles and is automatically recharged by a geared motor each time after closing.

It consists of:


- the stored energy operating mechanism which stores in springs the energy required to open and close the device
- a manual lever-operated spring arming device
- a geared electrical arming device which automatically re-arms the control mechanism as soon as the circuit breaker is closed (optional)
- manual order devices by push buttons on the front panel of the device
- an electrical remote closing device containing a release with an antipumping relay
- an electrical opening order device comprising one or several release units which can be of the following type:
 - shunt opening
 - undervoltage
 - Mitop, a low consumption release, used only with the Sepam 100 LA protection relay.
- an operation counter
- an "open/closed" position indicator device with a mechanical indicator
- a device for indicating "charged" operating mechanism status by mechanical indicator and electrical contact (optional)
- a module of 14 auxiliary contacts whose availability varies according to the diagram used.

Wiring diagram (principle)

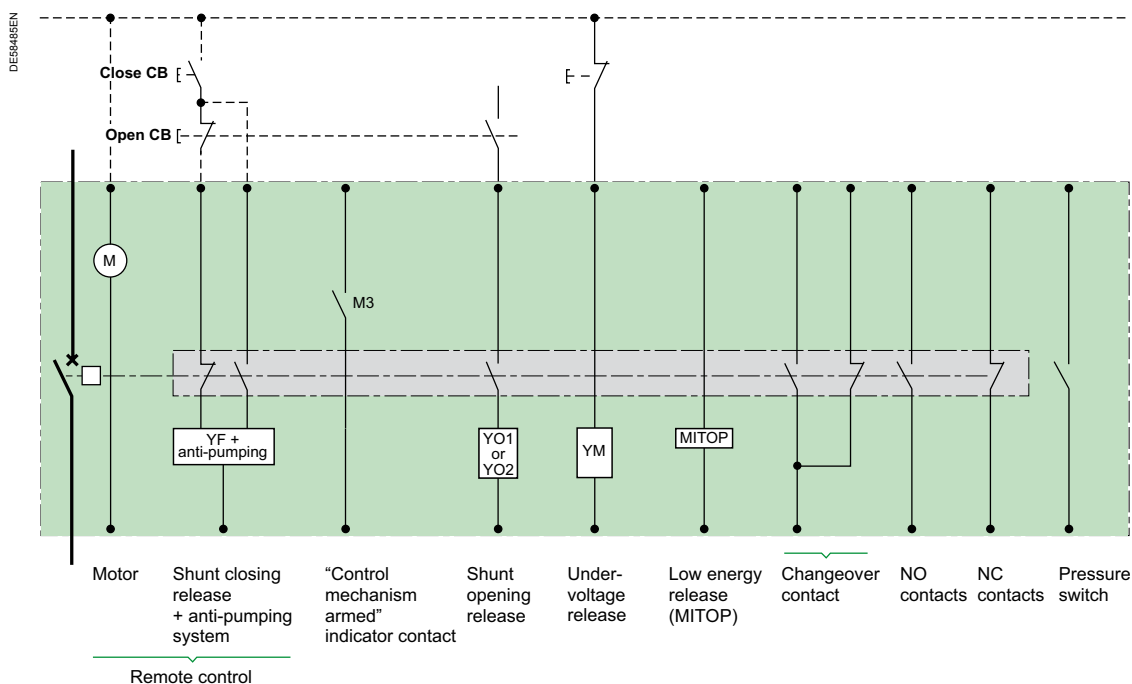


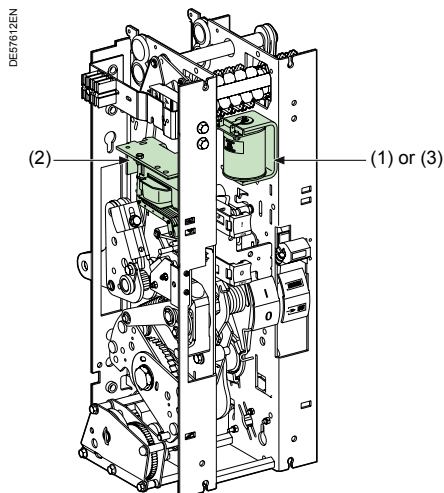


Operating mechanism



Shunt opening release (1)



Undervoltage release (2)



Low energy release (3)

Composition

The opening circuit can be produced using the following components:

- a shunt opening release (on energizing) (YO1)
- a second shunt opening release (on energizing) (YO2)
- undervoltage release (YM)
- low energy release (Mitop).

Note: see the table of the releases' combinations page "Order form".

Shunt opening release (YO1 and YO2)

Energizing this unit causes instant opening of the circuit breaker.

Characteristics

Power supply	See "Order form" page	
Threshold	V AC	0.85 to 1.1 Ur
	V DC	0.7 to 1.1 Ur
Consumption	V AC	160 VA
	V DC	50 W

Undervoltage release (YM)

This release unit causes the systematic opening of the circuit breaker when its supply voltage drops below a value less than 35% of the rated voltage, even if this drop is slow and gradual. It can open the circuit breaker between 35% and 70% of its rated voltage. If the release unit is not supplied power, manual or electrical closing of the circuit breaker is impossible. Closing of the circuit breaker is compulsory when the supply voltage of the release unit reaches 85% of its rated voltage.

Characteristics

Power supply	See "Order form" page		
Threshold		Opening	0.35 to 0.7 Ur
		Closing	0.85 Ur
Consumption	Triggering	V AC	400 VA
		V DC	100 W
	Latched	V AC	100 VA
		V DC	10 W


Low energy release (Mitop)

This specific release unit comprises a low consumption unit and is specifically used for Sepam 100LA self-powered relays.


Characteristics

Power supply	Direct current
Threshold	$0.6 A < I < 3 A$


Any tripping due to the Mitop release unit is momentarily indicated by an SDE type changeover contact (option).

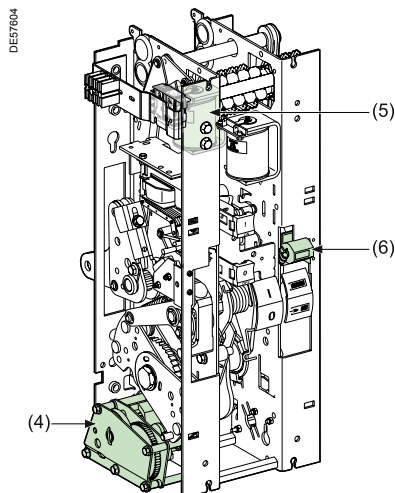


Operating mechanism



Electrical motor with gearing (4)



Shunt closing release (5)



Operation counter (6)

Function

Remote control enables the remote opening and closing of the circuit breaker.

Composition

The remote control mechanism comprises:

- an electrical motor with gearing
- a shunt closing release (YF) combined with an anti-pumping device
- an operation counter.

Electrical motor with gearing (M)

The electrical motor carries out the automatic rearming of the stored energy unit as soon as the circuit breaker is closed. This allows the instant reclosing of the device after opening. The arming lever is only used as a backup operating mechanism in the case of the absence of the auxiliary power supply. The M3 contact indicates the end of arming operations.

Characteristics

Power supply	See "Order form" page	
Threshold	V AC/V DC	0.85 to 1.1 Ur
Consumption	V AC	380 VA
	V DC	380 W

Shunt closing release (YF)

This release allows the remote closing of the circuit breaker when the operating mechanism is armed.

Characteristics


Power supply	See "Order form" page	
Threshold	V AC	0.85 to 1.1 Ur
	V DC	0.85 to 1.1 Ur
Consumption	V AC	160 VA
	V DC	50 W

The shunt closing release is combined with an anti-pumping relay that enables priority to be given to opening in the case of a permanent closing order. This thus avoids the device being caught in an uncontrolled opening-closing cycle.


Operation counter

The operation counter is visible on the front panel.

It displays the number of switching cycles (CO) that the device has carried out.

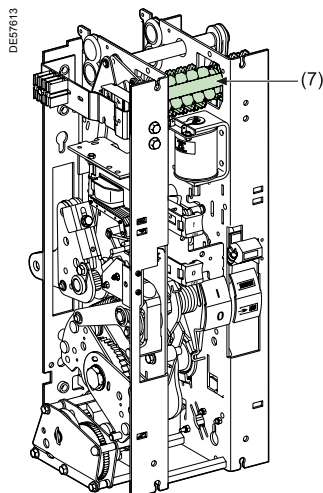

Operating mechanism



Auxiliary contacts (7)

“Open/closed” auxiliary contacts

The number of contacts available depends on the options chosen on the operating mechanism.

In the basic configuration, the circuit breaker's operating mechanism comprises a total of:

- 5 normally closed contacts (NC)
- 5 normally open contacts (NO)
- 1 changeover contact (CHG).

The usage procedure for auxiliary contacts is given in the following table:

Options		
	NC contact	NO contact
Shunt opening release (each one)	0	1
Undervoltage release	0	0
Low energy release (Mitop)	0	0

In order to know the final number of available contacts, you must deduct the total number of contacts included in the circuit breaker (5 NC + 5 NO + 1 CHG), the number of contacts used given in the table above.

E.g.: a circuit breaker equipped with a remote control and a shunt trip unit has the following available contacts:

5 NC + 4 NO + 1 CHG.

With a undervoltage release instead of the shunt trip, this circuit breaker would have the following available contacts:

5 NC + 5 NO + 1 CHG.

Shunt opening release combination			
	1st release	Shunt opening release YO1	Undervoltage release YM
2nd release			
Without		5NC + 4NO + 1CHG	5NC + 5NO + 1CHG
Shunt opening release YO2		5NC + 3NO + 1CHG	5NC + 4NO + 1CHG
Undervoltage release YM		5NC + 4NO + 1CHG	
Mitop		5NC + 4NO + 1CHG	5NC + 5NO + 1CHG

Description of functions




Safety functions

This table describes the safety functions available on the Evolis HP circuit breaker.

How to use the table

Each of the boxes describes the functional status of each circuit breaker position and the associated parts:

-  Possible status
-  Possible status, impossible operation
-  Impossible status

Parts		Circuit breaker positions					
			Insertion -----> Extraction -----<			Racking-in -----> Racking-out -----<	
		Removed		Disconnected	Test position		Service
1 - Cassette			Fool-proof protection ⁽¹⁾ Anti-drop ⁽²⁾				
		No opening shutters					
		Shutters padlocking possible					
2 - LV plug	Disconnected			No door closing			
	Connected				No unplugging ⁽⁵⁾		
3 - Circuit breaker	Closed		Auto-discharge function ⁽³⁾		No racking-in		No racking-out
	Open				No closing		
		Open position circuit breaker locking available ⁽³⁾					
4 - Switchboard door	Open				No racking-in		
	Closed				No door opening ⁽⁴⁾		
5 - Earthing switch	Open					No earthing switch closing	
	Closed				No racking-in		

⁽¹⁾ This protection mechanism ensures that the performance levels of the circuit breaker correspond with those of the cassette.

⁽²⁾ Device that prevents the circuit breaker from dropping when extracted from the cassette.

⁽³⁾ Option.


⁽⁴⁾ Interlocking device to be fitted to the cubicle door.

⁽⁵⁾ Because the door is closed.

Device

Withdrawable with MC3 cassette

Dimensions (mm)	W	886
	H	980
	D	902
Weight (kg)		338

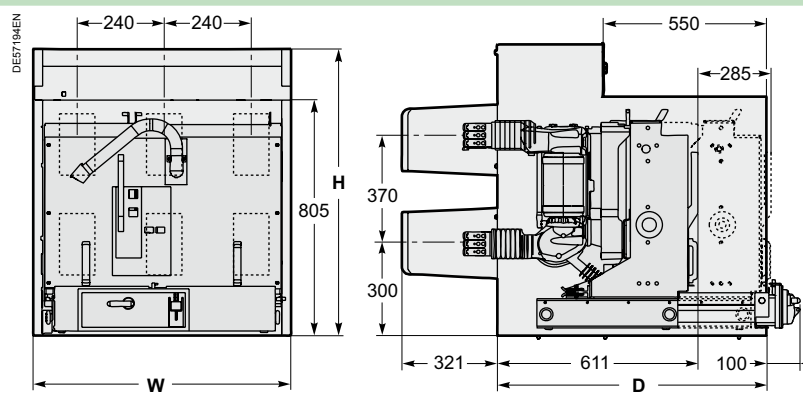

Only one of the boxes (ticked ☒ or filled ☐ by the needed value) have to be considered between each horizontal line.

Green box ☒ corresponds to none priced functions.

Releases combinations table

YO1/YO2	1	2	1	1	1
YM	1		1		1
Mitop				1	1

Basic withdrawable circuit breaker

Quantity

Rated voltage Ur (kV)

Impulse voltage Up (kVbil)

Short-circuit current I_{sc} (kA)

Rated current Ir (A)

Frequency 50 Hz ☒ 60 Hz ☐

Colour for push buttons and indicators

Push buttons open/closed: Red/black ☒

Indicator open/closed: Black/white ☒ Green/red ☐

Operating mechanism charged/discharged: White/yellow ☒ charged/discharged ☐

Circuit breaker options

Opening release (see possible choices in combination table)

Shunt opening release YO1

24 Vdc ☒ 110 Vdc ☒ 220 Vdc ☒ 110 Vac (50 Hz) ☒
48 Vdc ☒ 125 Vdc ☒ 220 Vac (50 Hz) ☒ 120 Vac (60 Hz) ☒

Shunt opening release YO2

24 Vdc ☐ 110 Vdc ☐ 220 Vdc ☐ 110 Vac (50 Hz) ☐
48 Vdc ☐ 125 Vdc ☐ 220 Vac (50 Hz) ☐ 120 Vac (60 Hz) ☐

Undervoltage release YM

24 Vdc ☐ 110 Vdc ☐ 220 Vdc ☐ 110 Vac (50 Hz) ☐
48 Vdc ☐ 125 Vdc ☐ 220 Vac (50 Hz) ☐ 120 Vac (60 Hz) ☐

Low energy release Mitop Without contact ☐ With contact ☐

Remote control

Electrical motor M 24...32 Vdc ☒ 110...127 Vdc/ac ☒
48...60 Vdc/ac ☒ 220...250 Vdc/ac ☒

Shunt closing release YF

24 Vdc ☒ 110 Vdc ☒ 220 Vdc ☒ 110 Vac (50 Hz) ☒
48 Vdc ☒ 125 Vdc ☒ 220 Vac (50 Hz) ☒ 120 Vac (60 Hz) ☒

MC cassette

MC cassette type MC3

Short-circuit current I_{sc} ≤ 40 kA 50 kA

Rated current Ir 1250 A 2500 A 3150 A

MC cassette accessories

Racked in/out position contact 3 NO, 3 NC 6 NO, 6 NC

Pictogram of the circuit breaker of the earthing sw.

Discharge of the circuit breaker control mechanism springs

Extraction table Quantity








Extra handle Quantity

Door with handle, windows and pictogram

Door accessories (local manufacture): handle, windows and pictogram

with cover plate

The following components can be ordered separately and can be adapted or replaced by the customer.

Remote control			Ref.
Shunt opening release YO1 or YO2			
	24 Vdc		AAA10 115
	48 Vdc		AAA10 116
	110 Vdc		AAA10 117
	125-127 Vdc		AAA10 118
	220 Vdc		AAA10 119
	110 Vac	50 Hz	AAA10 120
	220-230 Vac	50 Hz	AAA10 121
	120 Vac	60 Hz	AAA10 122
Shunt closing release YF			
	24 Vdc		AAA10 106
	48 Vdc		AAA10 107
	110 Vdc		AAA10 108
	125-127 Vdc		AAA10 109
	220 Vdc		AAA10 110
	110 Vac	50 Hz	AAA10 111
	220-230 Vac	50 Hz	AAA10 112
	120 Vac	60 Hz	AAA10 113
Undervoltage release YM			
	24 Vdc		AAA10 124
	48 Vdc		AAA10 125
	110 Vdc		AAA10 126
	125-127 Vdc		AAA10 127
	220 Vdc		AAA10 128
	110 Vac	50 Hz	AAA10 129
	220-230 Vac	50 Hz	AAA10 130
	120 Vac	60 Hz	AAA10 131
Low energy release Mitop			
	Without contact		0889308A
	With contact		0889308B
Electrical motor			
	24...32 Vdc		AAA10 027
	48...60 Vac/cc		AAA10 028
	100...127 Vac/cc		AAA10 029
	220...250 Vac/cc		AAA10 030
	Gear reducer		AAA10 065
Accessories			
MC cassette			
	MC3 (I _r up to 1250 A)		51237324FW
	MC3 (I _r greater than 1250 A)		51237324FS
Rack-in/rack-out operation			
	Operating shaft		03405140FO

The following components can only be adapted or replaced on site by staff trained by Schneider Electric

- Remote control mechanism (comprising: electrical motor, gear reducer, shunt closing release, operation counter)
- Operation counter
- Low energy release (Mitop)
- Interlocking between the “open” circuit breaker position and the LV plug
- Racking truck
- Discharging the extraction control mechanism.

Schneider Electric Industries SAS

35, rue Joseph Monier
CS 30323
F - 92506 Rueil Malmaison Cedex

RCS Nanterre 954 503 439
Capital social 896 313 776 €
www.schneider-electric.com

As standards, specifications and designs change from time to time, please ask for confirmation of the information given in this publication.



*This document has been printed
on ecological paper*

Publishing: Schneider Electric Industries SAS
Design: Schneider Electric Industries SAS
Printing: Altavia Connexion