

Existing & Harmonised Cable Identification

31/3/2004 until 30/3/2006


May use old existing or new harmonised colours but not both on same installation

31/3/2006 Onwards


Only new harmonised colours must be used

Existing


6242Y
6242B



6243Y
6243B



6942XL
6942LS




Twin flat

Triple flat


Two core
armoured

Harmonised


6242YH
6242BH



6243YH
6243BH



6942XLH
6942LSH




Single Phase




Extensions or alterations to existing single-phase installations do not require marking at interface between old and new cabling. Caution labels must be fixed at distribution board or consumer unit.

6943XL
6943LS



Three core
armoured

6943XLH
6943LSH



6944XL
6944LS




Four core
armoured

6944XLH
6944LSH



Three Phase

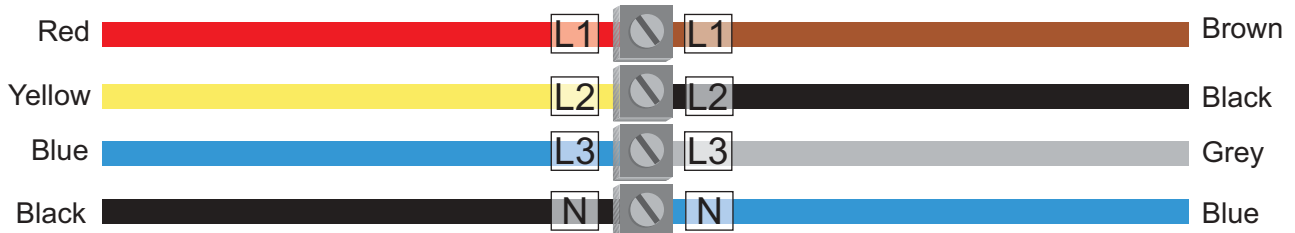

Extensions or alterations to existing three-phase installations - all old and new cables should be marked L1, L2, L3 for phases and N for neutral at the interface between old and new cabling. Caution labels must be fixed at distribution board.