


Trip unit Ekip Dip LSIG XT7

The rating of the CB can be selected, the protection settings made and the curve and entered values displayed in this section.

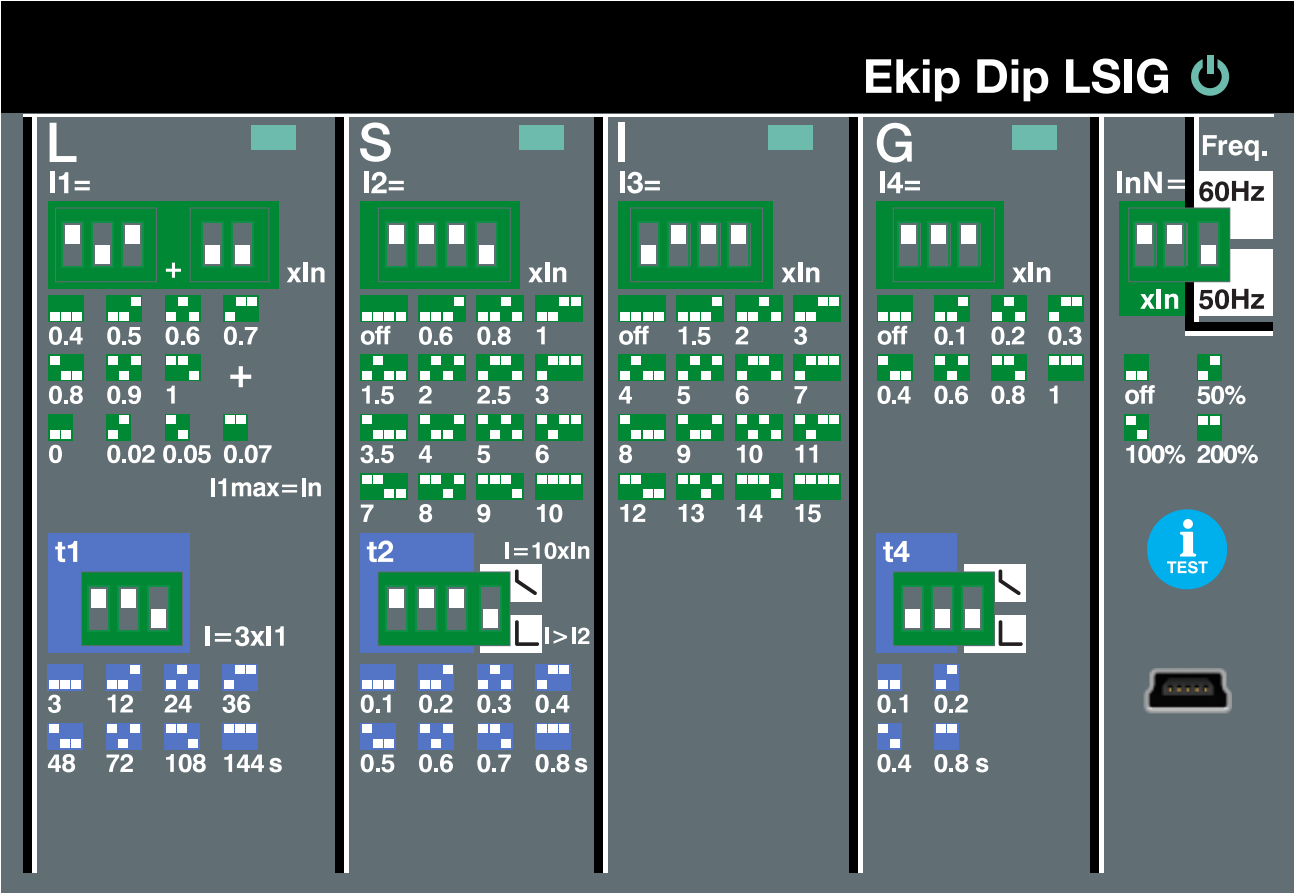

In	Neutral	Frequency			
1000	InN 200% x 1000 (In)	50 Hz			
	Current threshold (A)	Current intensity (A)		Actuation time (sec)	
L	0.9 x 1000 (In)	900.00	I1	108	t1
S	9 x 1000 (In)	9000.00	I2	0.8	t2
I	7 x 1000 (In)	7000.00	I3		
G	1 x 1000 (In)	1000.00	I4	0.1	t4

WARNING, I3 threshold must be be higher than I2 threshold

